

Liebert® Air-Cooled Fin/Tube Condensers

Technical Data Manual—50 & 60Hz



TABLE OF CONTENTS

1.0	INTRODUCTION	1
1.1	Product Description	1
1.2	Agency Listed	1
1.3	Location	1
1.4	Liebert Condenser Model Number Nomenclature	2
2.0	STANDARD FEATURES	3
2.1	Standard Features—All Condensers	3
2.1.1	Condenser Coil	3
2.1.2	Housing	3
2.1.3	Propeller Fan	3
2.1.4	Fan Motor	3
2.1.5	Electrical Controls	3
3.0	SPECIFIC CONDENSER TYPES—FEATURES	4
3.1	Head Pressure Control Types	4
3.1.1	Fan Speed	4
3.1.2	Variable Frequency Drive	4
3.1.3	Liebert Lee-Temp™ Refrigerant Control	4
3.2	Sound Level Options	4
3.2.1	Standard Condenser	4
3.2.2	Liebert Quiet-Line Condenser	4
3.3	Surge Protective Device—Optional	4
3.4	Typical System Configurations	5
4.0	CONDENSER PERFORMANCE DATA	6
5.0	DIMENSIONS AND WEIGHTS	8
5.1	Condenser Dimensions and Anchor Plan	8
5.2	Condenser Weights and Connection Sizes	12
6.0	ELECTRICAL DATA	14
6.1	Electrical Connections	15
7.0	REFRIGERANT PIPING AND CHARGE PLANNING	18
7.1	Refrigerant Piping Configurations	18
7.2	Refrigerant Charge Planning Values	24
	GUIDE SPECIFICATIONS	26

FIGURES

Figure 1	Liebert two-fan condenser	1
Figure 2	Piping schematic, air-cooled with scroll or digital scroll compressor models	5
Figure 3	Condenser planning dimensional data—One-fan and two-fan units.	8
Figure 4	Condenser planning dimensional data—Three-fan and four-fan units.	9
Figure 5	Condenser planning dimensional data—Six- and eight-fan units	10
Figure 6	Typical fin/tube condenser footprint—dimensions	11
Figure 7	Electrical field connections for Fan Speed Control Condensers.	15
Figure 8	Electrical field connections for VFD control condensers.	16
Figure 9	Electrical field connections for Liebert Lee-Temp™ control condensers	17
Figure 10	Single-circuit piping, VFD and Fan Speed Control, 1-4 fan condensers	18
Figure 11	Dual-circuit piping, VFD and Fan Speed Control, 1-4 fan condensers	19
Figure 12	Dual-circuit piping, Fan Speed Control, 6- and 8-fan condensers	20
Figure 13	Single-circuit piping, Liebert Lee-Temp™ and Liebert Quiet-Line™ 1-4 fan condensers.	21
Figure 14	Dual-circuit piping, Liebert Lee-Temp™ and Liebert Quiet-Line™ 1-4 fan condensers	22
Figure 15	Dual-circuit piping, Liebert Lee-Temp and Liebert Quiet-Line 6- and 8-fan condensers	22
Figure 16	General arrangement—Air-cooled models with Liebert Lee-Temp™ control	23

TABLES

Table 1	Condenser performance data, 60Hz, R-407C	6
Table 2	Condenser performance data, 60Hz, R-410A	6
Table 3	Condenser performance data, 50Hz, R-407C	7
Table 4	Condenser net weights and pipe connection sizes.	12
Table 5	Liebert Lee-Temp™ receiver weights and piping connections	13
Table 6	60Hz electrical condenser data.	14
Table 7	60Hz condenser electrical data, Liebert Quiet-Line™	14
Table 8	50Hz condenser full load amp values.	14
Table 9	Liebert Lee-Temp™ receiver electrical data, 50Hz and 60Hz	15
Table 10	R-22 and R-407C refrigerant required, approximate	24
Table 11	R-407C refrigerant required for DCSL616 condensers for Liebert XDC™, approximate	24
Table 12	Interconnecting piping refrigerant charge	25
Table 13	R-410A refrigerant required, approximate	25

1.0 INTRODUCTION

1.1 Product Description

The Liebert fin/tube condenser is a low-profile, direct-drive propeller fan-type air-cooled unit suitable for mounting outdoors. It provides for the heat rejection of either one or two separate refrigeration circuits, matching heat rejection capacity varying with the outdoor ambient temperatures and with each corresponding compressors heat rejection requirements. Constructed with an aluminum cabinet and a copper-tube aluminum fin coil, the unit is quiet and corrosion resistant. The condenser is quickly and easily installed because all internal wiring is completed at the factory with only electrical connections to be made at the job site. All electrical connections and controls are enclosed in an integral weatherproof section of the condenser.

Figure 1 Liebert two-fan condenser



1.2 Agency Listed

Standard 60Hz units are CSA certified to the harmonized U.S. and Canadian product safety standard, CSA C22.2 No 236/UL 1995 for “Heating and Cooling Equipment” and are marked with the CSA c-us logo.



1.3 Location


When considering installation locations, consider that these units reject heat into the atmosphere and should be located in a clean air area, away from loose dirt and foreign matter that may clog the coil. In addition, condensers must not be located in the vicinity of steam, hot air or fume exhausts. Condensers should be located no closer than 3 feet from a wall, obstruction or adjacent unit with no obstructions over the unit. Install condensers in a level position to assure proper refrigerant flow and oil return. Condensers must be installed in vertical airflow orientation to ensure NEMA 3R rating of electrical box.

Do not mount condensers in areas where normal unit operating sound levels might disturb the working or residential environments of others.

Use caution when installing condensers below the indoor unit. Fan Speed and VFD condensers must not be installed more than 15ft. (4.6m) below the indoor unit; Liebert Lee-Temp™ condensers should be installed above or at the same level as the indoor unit. Contact the factory for assistance in specifying subcooling coils to each circuit to extend these limits.

1.4 Liebert Condenser Model Number Nomenclature

Example: DCDF165-Y

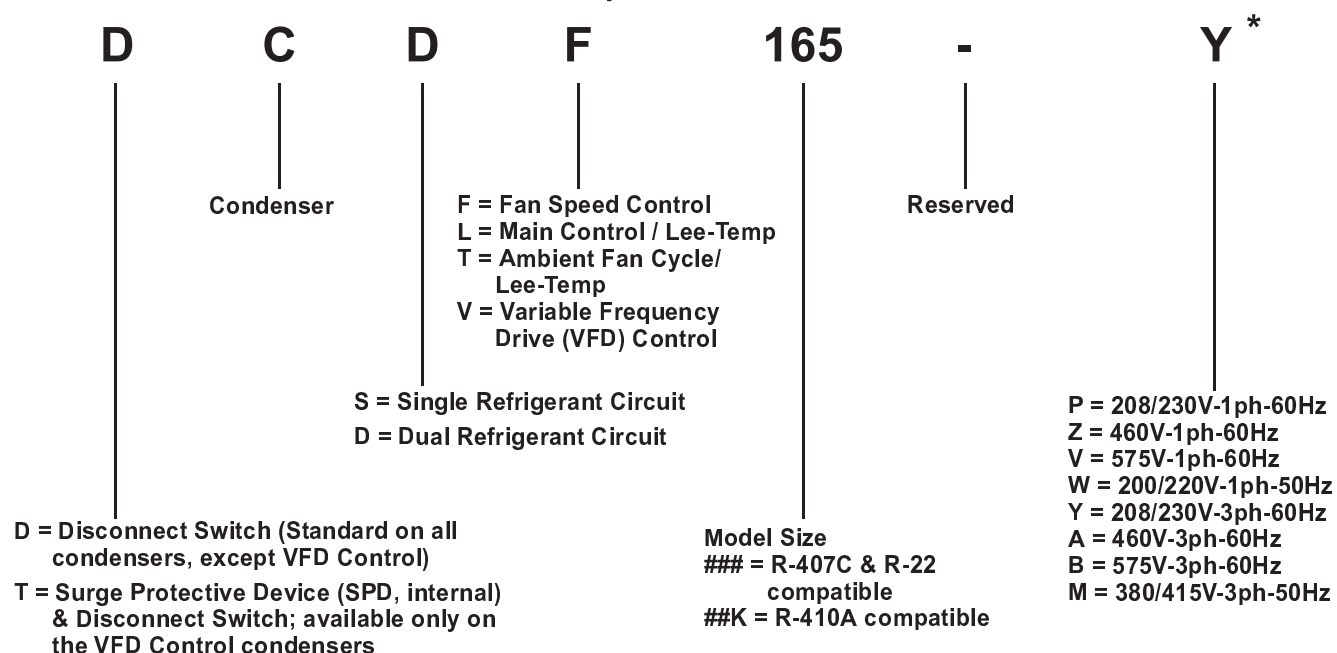

NOT ALL POSSIBLE COMBINATIONS OF MODELS,
CONTROLS AND VOLTAGES ARE AVAILABLE.

* Single-phase voltage is only voltage available as standard
on Fan Speed Control 1-fan condensers

* Three-phase voltage is only voltage available as standard
on condensers with VFD Control, Lee-temp receivers, and
Fan Speed Control (2-8 fan models only).

* VFD Control Condensers are not available in 575-3-60.



NOTE

Not all model/options/voltage combinations are available.

2.0 STANDARD FEATURES

2.1 Standard Features—All Condensers

Liebert condensers consist of condenser coil(s), housing, propeller fan(s) direct-driven by individual fan motor(s), electrical controls and mounting legs. Liebert air-cooled condensers provide positive refrigerant head pressure control to the Precision Cooling indoor unit by adjusting heat rejection capacity. Various methods are employed to match indoor unit type, minimum outdoor design ambient and maximum sound requirements.

2.1.1 Condenser Coil

Liebert-manufactured coils are constructed of copper tubes in a staggered tube pattern. Tubes are expanded into continuous, corrugated aluminum fins. The fins have full-depth fin collars completely covering the copper tubes, which are connected to heavy wall Type “L” headers. Inlet coil connector tubes pass through relieved holes in the tube sheet for maximum resistance to piping strain and vibration. Coils are either single circuit or dual circuit, depending on the application. The hot-gas and liquid lines are spun shut at the factory and include a factory-installed Schrader valve. Coils are factory leak-tested at a minimum of 300 psig (2068kPag), dehydrated, then filled and sealed with a low pressure inert gas holding charge for shipment.

2.1.2 Housing

The condenser housing is fabricated from bright aluminum sheet and divided into individual fan sections by full width baffles. Structural support members, including coil support frame, motor and drive support, are galvanized steel for strength and corrosion resistance. Aluminum legs are provided for mounting unit for vertical discharge and have rigging holes for hoisting the unit into position. The unit’s electrical panel is inside an integral NEMA 3R weatherproof section of the housing.

2.1.3 Propeller Fan

Aluminum propeller fan blades are secured to a corrosion-protected steel hub. Fan guards are heavy gauge, close-meshed steel wire with corrosion resistant PVC finish rated to pass a 675-hour salt spray test. Fans are secured to the fan motor shaft by a keyed hub and dual setscrews. Fan diameter is 26" (660mm) or less. The fans are factory-balanced and run before shipment.

2.1.4 Fan Motor

The condenser’s fan motor is a continuous air-over design equipped with rain shield and permanently sealed bearing. Die-formed, galvanized steel supports are used for rigid mounting of the motor.

2.1.5 Electrical Controls

Electrical controls, overload protection devices and service connection terminals are factory-wired inside the integral electrical panel section of the housing. A locking disconnect switch is factory-mounted and wired to the electrical panel and controlled via an externally mounted locking door handle. An indoor unit interlock circuit enables condenser operation whenever indoor unit compressors are active. Only supply wiring and indoor unit interlock wiring are required at condenser installation.

3.0 SPECIFIC CONDENSER TYPES—FEATURES

3.1 Head Pressure Control Types

3.1.1 Fan Speed

Fan speed control utilizes a wave-chopper control to vary the air volume over the condenser coil, based on refrigerant head pressure. The fan motor next to the electrical panel (two fans on 6-fan and 8-fan models) is a single-phase, permanent split capacitor motor with motor speed adjusted in response to refrigerant pressure. The balance of fans on multi-fan units cycle on ambient thermostats. The control system provides refrigerant head pressure control for outdoor ambients as low as -20°F (-28.9 °C).

3.1.2 Variable Frequency Drive

VFD condenser control system utilizes a variable frequency drive, inverter duty fan motor operating from 0% to 100% motor RPM based on head pressure, sensed by refrigerant pressure transducers. VFD, ambient-temperature thermostat(s), motor overload protection and electrical control circuit are factory-wired in the integral control panel. VFD controls the fan adjacent to the connection end of the condenser and remains energized with active compressor operation. The balance of fans on multi-fan units cycle on ambient thermostats. This system provides refrigerant head pressure control for outdoor ambients as low as -20°F (-28.9°C).

3.1.3 Liebert Lee-Temp™ Refrigerant Control

The Liebert Lee-Temp head pressure control system is designed to maintain proper operating head pressures in outdoor temperatures down to -30°F (-34.4°C). The condensers utilize head pressure control valves, extra refrigerant and insulated refrigerant receivers with heater pads. It works by flooding the condenser coil with liquid refrigerant to a level that balances the system condensing requirements with the condenser coil surface available to reject the system heat. During the summer, the system requires the entire condenser coil surface for heat rejection and most of the refrigerant is stored in a receiver. In the winter, the same amount of heat can be rejected by only a fraction of the coil surface. As head pressure begins to fall, the control valve restricts the flow of liquid refrigerant exiting from the condenser. This extra liquid refrigerant reduces the effective condenser surface area available for heat transfer. The head pressure control valve also bypasses hot gas into the receiver to warm the liquid and maintain liquid pressure for proper operation of the expansion valve. Condenser fan controls are either fan cycling on ambient temperature or constant on. Liebert Lee-Temp control is required for Liebert Quiet-Line™ condensers.

3.2 Sound Level Options

3.2.1 Standard Condenser

All fan speed and VFD condensers are standard condensers with moderate operating sound levels. Liebert Lee-Temp condensers with standard-size coils matching fan speed and VFD coil sizes are standard sound level condensers.

3.2.2 Liebert Quiet-Line Condenser

Liebert Quiet-Line condensers can help your facility meet the strictest noise codes and do so at less cost than traditional condensers with acoustical shielding. Liebert Quiet-Line condensers utilize the same reliable construction features of the standard condensers and have oversized coils and slower speed fan motors which yield the required heat rejection needed at significantly lower sound levels. Liebert Lee-Temp control is required for Liebert Quiet-Line Condensers.

3.3 Surge Protective Device—Optional


A surge protective device (SPD) is standard in the VFD condenser models only. Surge protection is necessary because rooftop voltage supply often is not conditioned the same as the voltage supply inside a data center. The SPD is designed to protect sensitive electronic condenser components from high voltage transients, up to 25kVA/phase.

An illuminated green LED indicates power supply is On and panel status is OK. An illuminated red LED indicates conditions require service and the SPD may require replacement to restore surge protection to the condenser.

3.4 Typical System Configurations

Figure 2 shows a single refrigeration circuit diagram, displaying the indoor air conditioning unit, the outdoor condenser (VFD, Fan Speed Control or Liebert Lee-Temp™) and field-supplied interconnection piping.

Figure 2 Piping schematic, air-cooled with scroll or digital scroll compressor models

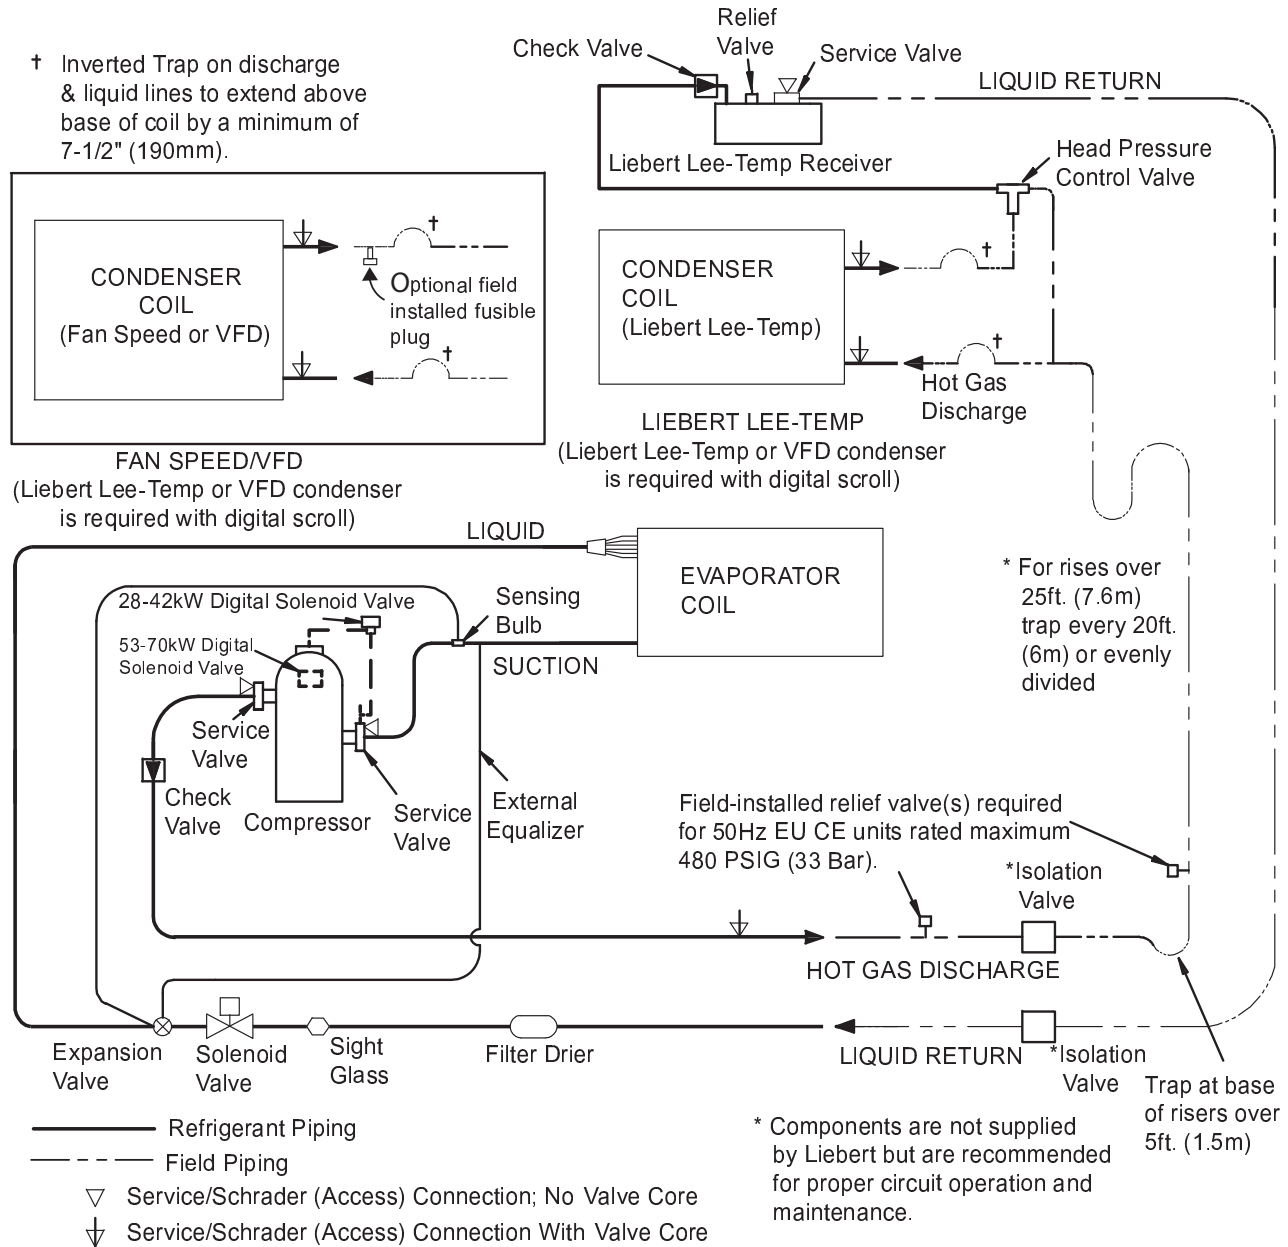

NOTES: Schematic representation shown. Do not use for specific connection locations.
Two refrigeration circuits provided. Single refrigeration circuit shown for clarity.

DPN000798
Rev. 5

4.0 CONDENSER PERFORMANCE DATA

Table 1 Condenser performance data, 60Hz, R-407C

Model #	Total Heat Rejection, kBtuh (kW) R-407C				Fans Direct Drive				Sound Power LwA	Sound Pressure dBA ³
	30°F (16.7°C) TD	25°F (13.9°C) TD	20°F (11.1°C) TD	15°F (8.3°C) TD	Qty	Diam.	HP	CFM		
Standard	90°F DB	95°F DB	100°F DB	105°F DB	—	—	—	—	—	—
083	102 (29.9)	82 (24.0)	63 (18.2)	43 (12.5)	1	26	3/4	5900	86.7	72.5
104	128 (37.3)	104 (30.4)	81 (23.5)	57 (16.7)	1	26	3/4	5500	86.6	72.5
165	208 (60.6)	167 (48.7)	127 (37.0)	87 (25.4)	2	26	3/4	11800	90.3	75.5
205	290 (84.7)	238 (69.5)	186 (54.3)	134 (39.1)	2	26	3/4	10300	91.0	75.5
251	301 (87.9)	243 (70.9)	185 (54.1)	129 (37.5)	3	26	3/4	17950	94.0	77.3
308	380 (110.9)	308 (89.9)	238 (69.3)	168 (49.0)	3	26	3/4	16650	93.8	77.3
415	601 (175.3)	491 (143.3)	383 (111.7)	278 (81.0)	4	26	3/4	20650	94.4	78.5
510	640 (186.6)	530 (154.7)	421 (122.9)	315 (91.8)	4	26	3/4	18200	94.4	78.5
616	760 (221.6)	619 (180.4)	475 (138.6)	336 (98.0)	6	26	3/4	33300	96.8	80.3
830	1200 (350.0)	983 (286.6)	765 (223.0)	555 (161.9)	8	26	3/4	41300	97.4	81.5
1010	1280 (373.3)	1061 (309.4)	846 (246.7)	627 (182.8)	8	26	3/4	36400	97.4	81.5
Liebert Quiet-Line™										
063	70 (20.5)	58 (16.9)	46 (13.3)	33 (9.7)	1	26	1/4	2425	68.9	56.5
119	123 (36.0)	100 (29.1)	77 (22.6)	55 (16.2)	2	26	1/4	5250	72.6	59.5
127	141 (41.0)	116 (33.7)	90 (26.4)	66 (19.2)	2	26	1/4	4850	72.6	59.5
143	148 (43.2)	123 (35.8)	98 (28.6)	73 (21.3)	2	26	1/4	4250	72.6	59.5
214	232 (67.5)	193 (56.1)	154 (45.0)	116 (33.9)	3	26	1/4	6400	74.8	61.3
286	312 (90.9)	260 (75.7)	209 (60.9)	157 (45.8)	4	26	1/4	8275	76.2	62.5
409	444 (129.4)	368 (107.2)	291 (84.8)	219 (63.8)	6	26	1/4	13750	78.4	64.3
572	623 (181.8)	519 (151.4)	417 (121.5)	312 (90.9)	8	26	1/4	17050	79.9	65.5

1. TD = Temperature difference between the Entering Air Temperature and Midpoint Condensing Temperature.

2. Capacity shown is the condenser's THR at sea level. If the condenser is a dual-circuit unit, each circuit's capacity is 1/2 of the THR shown.

3. Sound Pressure levels @ 5 ft. (1.5m)

Table 2 Condenser performance data, 60Hz, R-410A

Model #	Total Heat Rejection, kW (kBtuh) R-410A				Fans Direct Drive				Sound Power LwA	Sound Pressure dBA ⁴
	30°F (16.7°C) TD	25°F (13.9°C) TD	20°F (11.1°C) TD	15°F (8.3°C) TD	Qty	Diam.	HP	CFM		
Standard	90°F DB	95°F DB	100°F DB	105°F DB						
28K	31.6 (108)	26.4 (90)	20.5 (70)	15.0 (51)	1	26	3/4	5775	86.6	72.5
60K	74.2 (253)	60.4 (206)	46.8 (160)	34.0 (116)	2	26	3/4	11550	91.0	75.5
90K	118.6 (405)	97.2 (332)	76.0 (259)	55.0 (188)	3	26	3/4	17300	93.8	77.3

1. R-410A condensers are available only in 60 Hz.

2. TD = Temperature Difference between the Entering Air Temperature and Midpoint Condensing Temperature.

3. Capacity shown is the condenser's THR at sea level. If the condenser is a dual-circuit unit, each circuit's capacity is 1/2 of the THR shown.

4. Sound Pressure levels @ 5 ft. (1.5m)

Table 3 Condenser performance data, 50Hz, R-407C

Model #	Total Heat Rejection, kBtuh (kW) R-407C				Fans Direct Drive					
	30°F (16.7°C) TD	25°F (13.9°C) TD	20°F (11.1°C) TD	15°F (8.3°C) TD	Qty	Diam.	Hp	CFM	Sound Power LwA	Sound Pressure dBA ³
Standard	90°F DB	95°F DB	100°F DB	105°F DB	—	—	—	—	—	—
083	91 (26.6)	73 (21.4)	56 (16.3)	39 (11.3)	1	26	3/4	4900	81.7	68.3
104	112 (32.7)	92 (26.7)	71 (20.7)	51 (14.8)	1	26	3/4	4575	82.5	69.1
165	185 (54.0)	149 (43.5)	114 (33.2)	79 (23.0)	2	26	3/4	9800	85.9	71.8
205	251 (73.2)	206 (60.0)	161 (47.1)	118 (34.4)	2	26	3/4	8475	87.2	70.6
251	270 (78.8)	218 (63.6)	167 (48.7)	117 (34.1)	3	26	3/4	14900	89.4	73.5
308	333 (97.1)	271 (79.1)	210 (61.3)	149 (43.5)	3	26	3/4	13700	89.4	73.7
415	516 (150.4)	424 (123.8)	332 (96.9)	242 (70.5)	4	26	3/4	16950	91.0	75.7
510	542 (158.1)	450 (131.2)	360 (104.9)	269 (78.4)	4	26	3/4	14900	91.0	75.7
616	667 (194.5)	543 (158.4)	420 (122.6)	299 (87.2)	6	26	3/4	27450	92.4	76.7
830	1031 (300.8)	849 (247.5)	665 (194.0)	484 (141.3)	8	26	3/4	33900	94.0	78.7
1010	1085 (316.5)	900 (262.4)	721 (210.2)	538 (156.8)	8	26	3/4	29800	94.0	78.7
Liebert Quiet-Line™										
063	60 (17.5)	50 (14.5)	39 (11.4)	29 (8.4)	1	26	1/4	2000	65.6	53.2
119	108 (31.4)	87 (25.5)	68 (19.7)	50 (14.6)	2	26	1/4	4350	69.3	56.2
127	121 (35.2)	99 (28.9)	78 (22.7)	57 (16.5)	2	26	1/4	4000	69.3	56.2
143	124 (36.2)	104 (30.2)	83 (24.1)	61 (17.9)	2	26	1/4	3475	69.3	56.2
214	193 (56.2)	161 (47.0)	131 (38.1)	100 (29.1)	3	26	1/4	5225	71.5	58.0
286	258 (75.3)	216 (62.9)	174 (50.8)	132 (38.5)	4	26	1/4	6750	72.9	59.2
409	378 (110.3)	312 (91.1)	249 (72.7)	188 (54.9)	6	26	1/4	11250	75.1	61.0
572	472 (137.8)	392 (114.2)	310 (90.5)	229 (66.8)	8	26	1/4	13900	76.6	62.2

1. R-410A condensers are available only in 60 Hz.


2. TD = Temperature Difference between the Entering Air Temperature and Midpoint Condensing Temperature.


3. Sound Pressure levels at 5ft. (1.5m).

5.0 DIMENSIONS AND WEIGHTS

5.1 Condenser Dimensions and Anchor Plan

Figure 3 Condenser planning dimensional data—One-fan and two-fan units

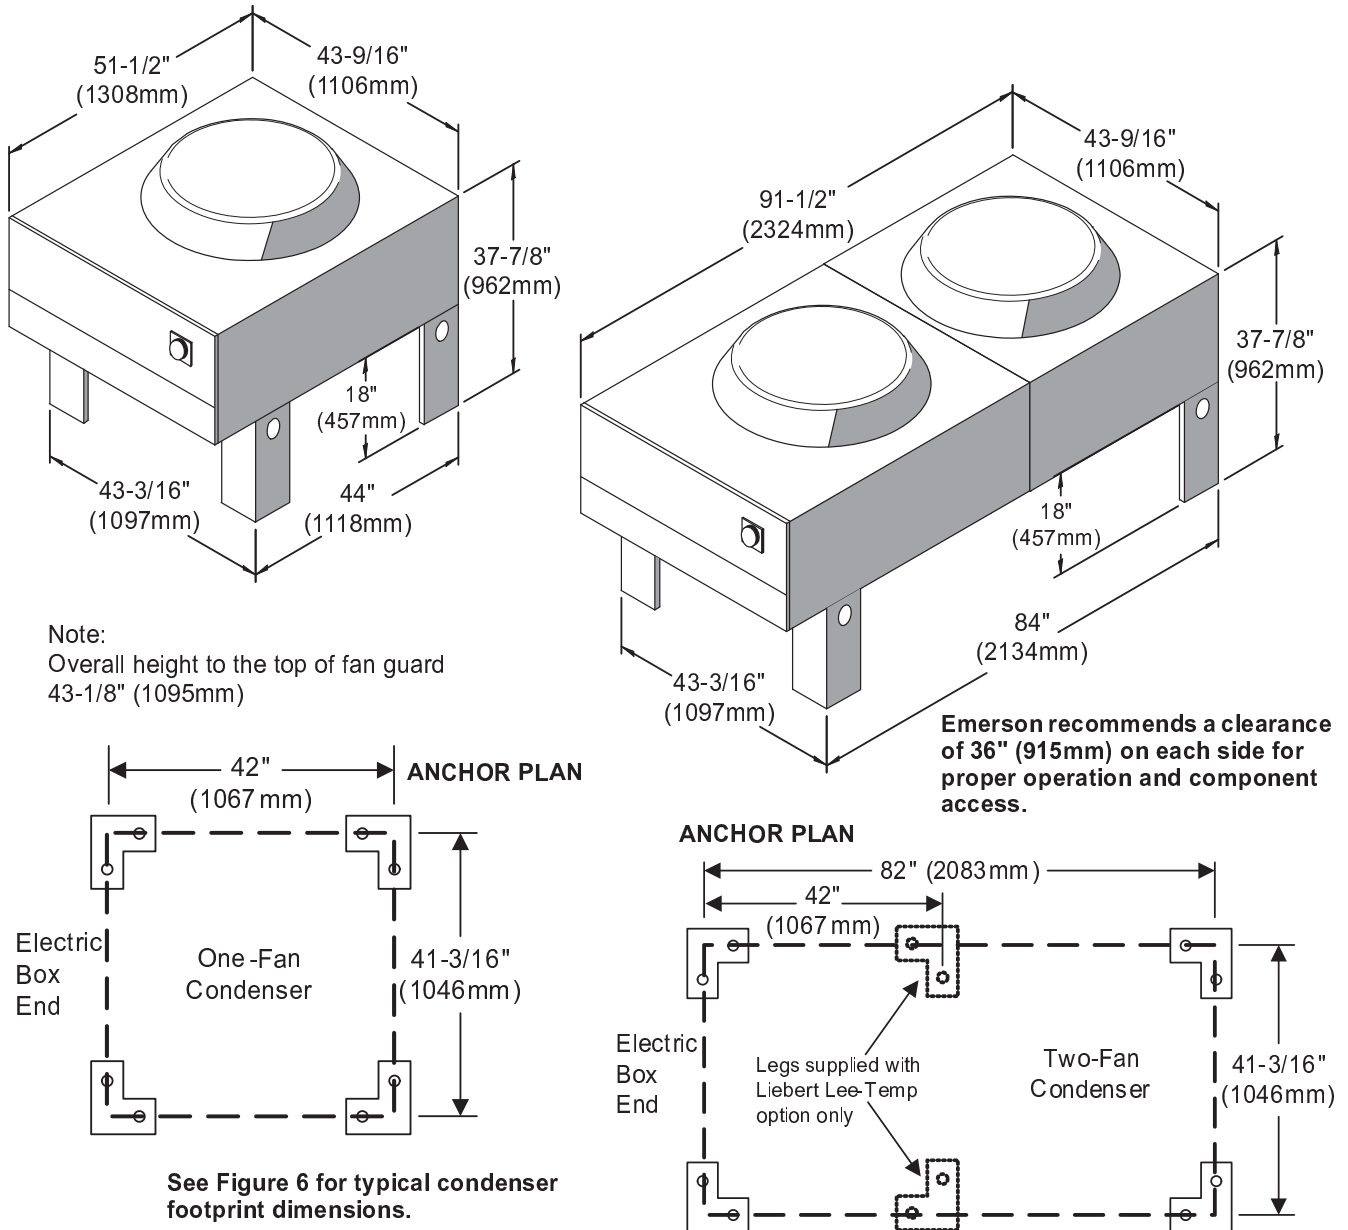



Emerson recommends a clearance of 36" (915mm) on each side for proper operation and component access.

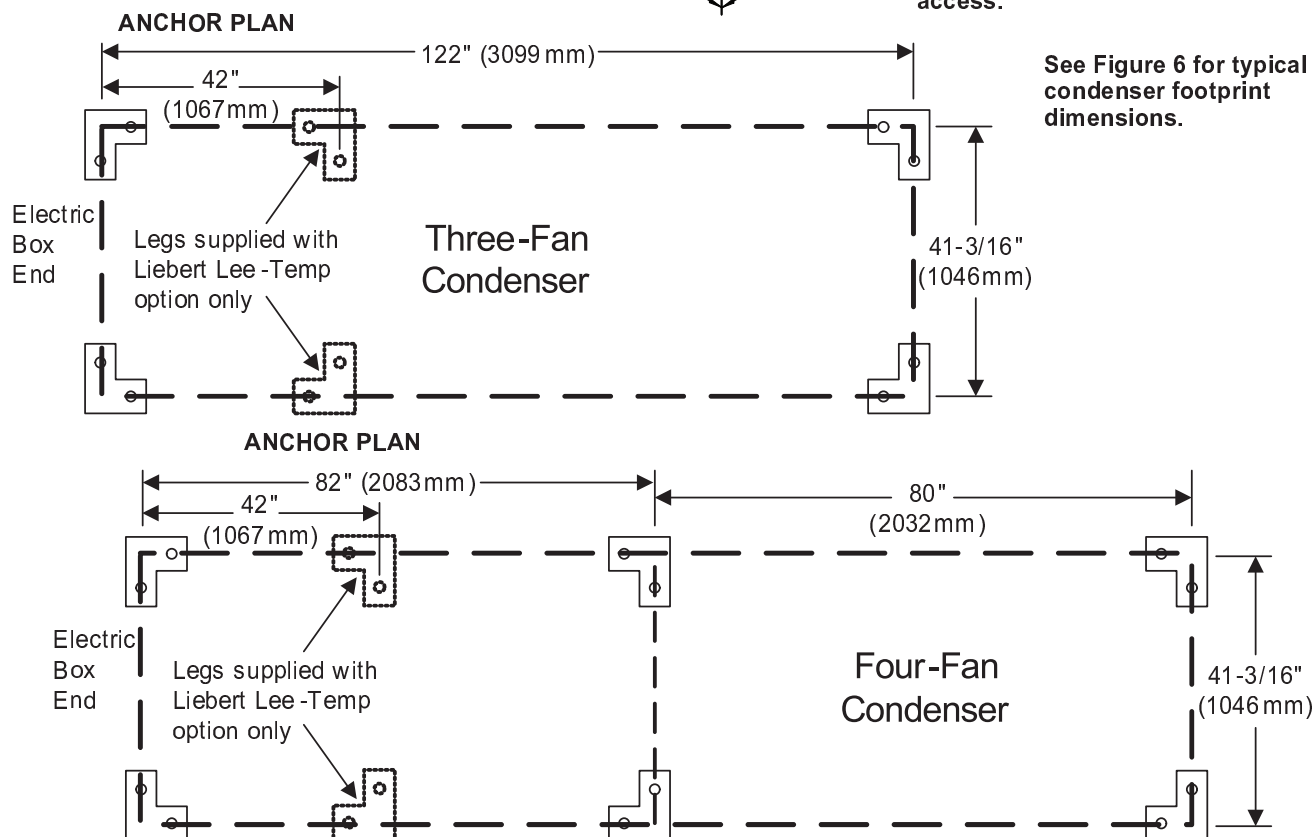


Figure 5 Condenser planning dimensional data—Six- and eight-fan units


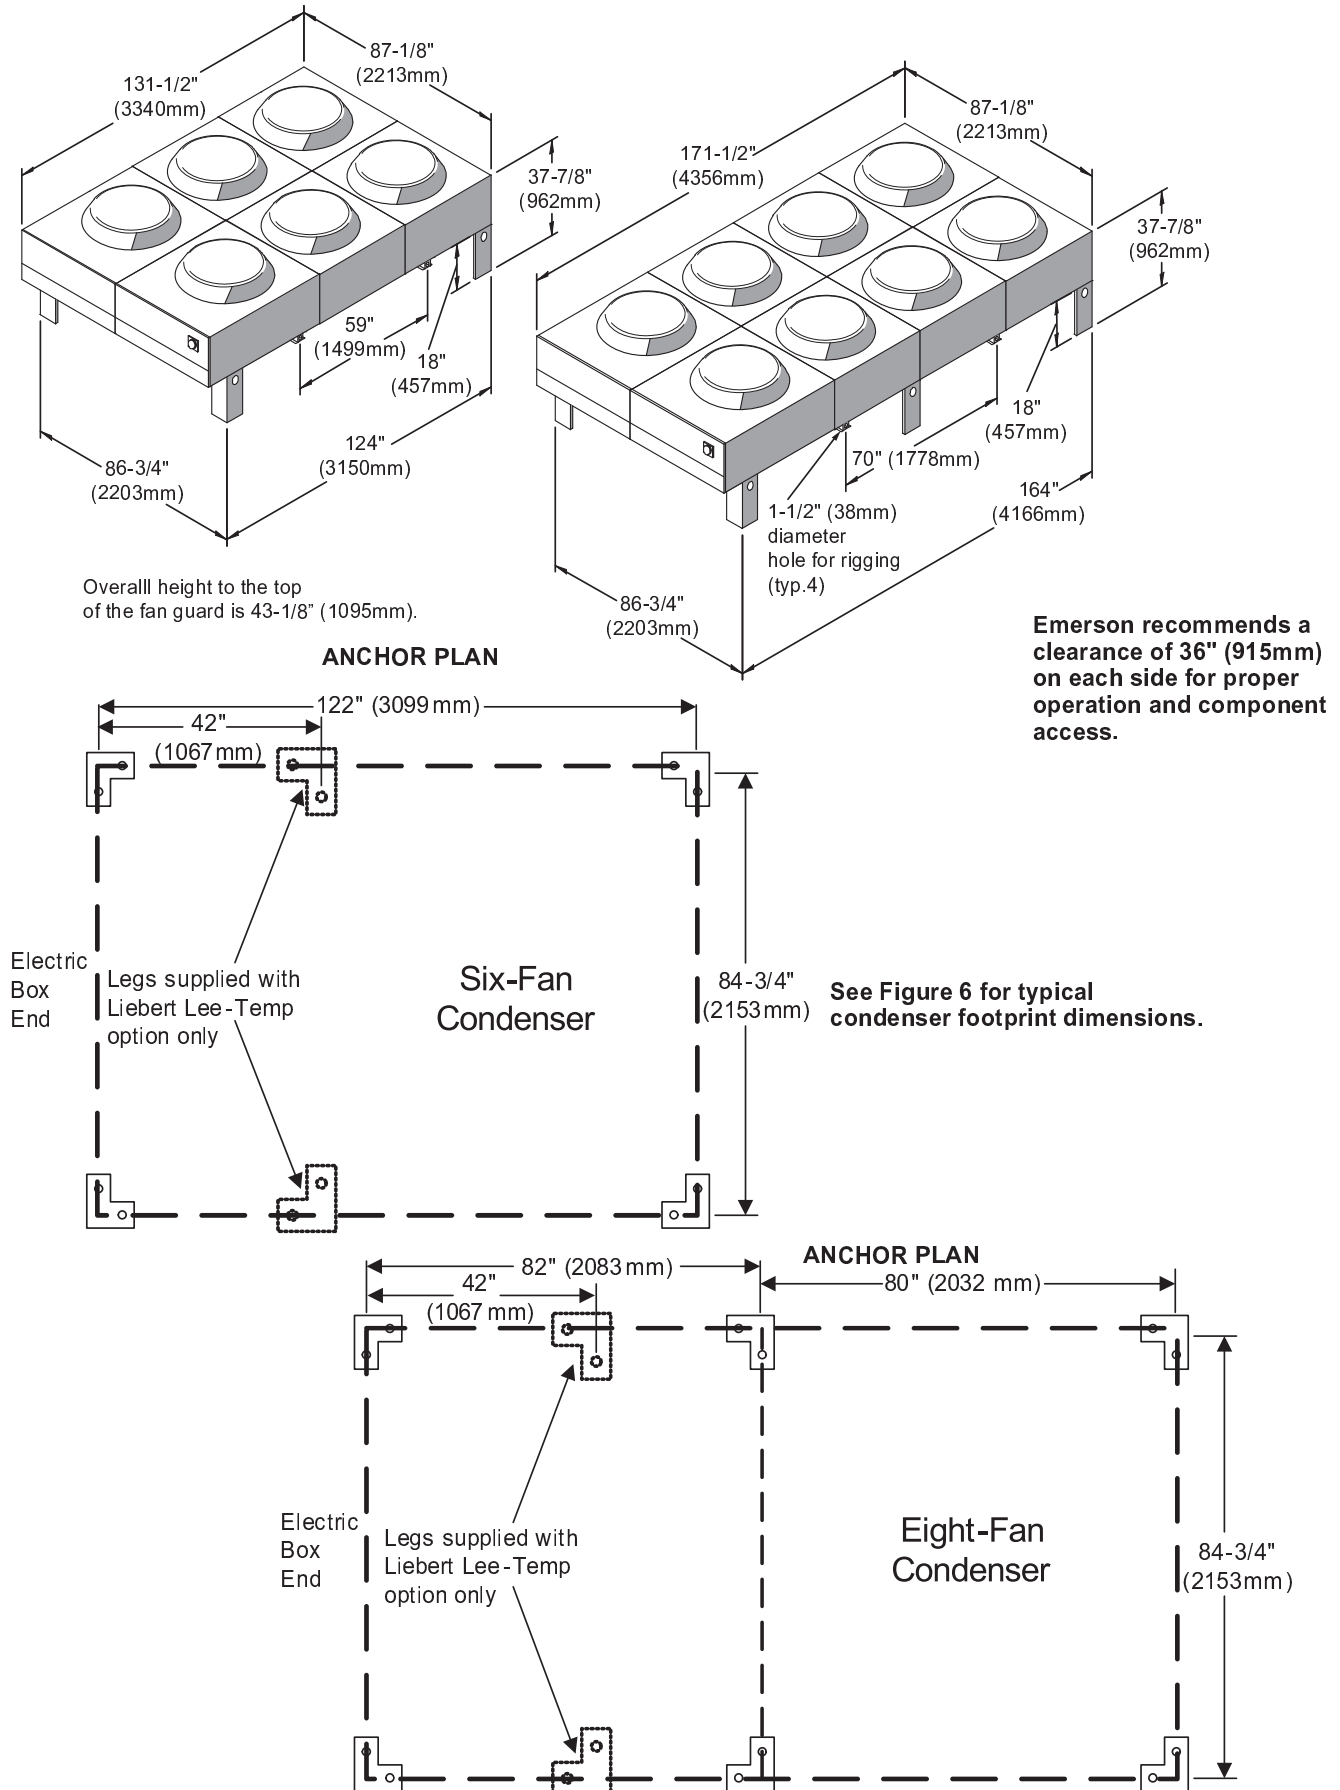


Figure 6 Typical fin/tube condenser footprint—dimensions

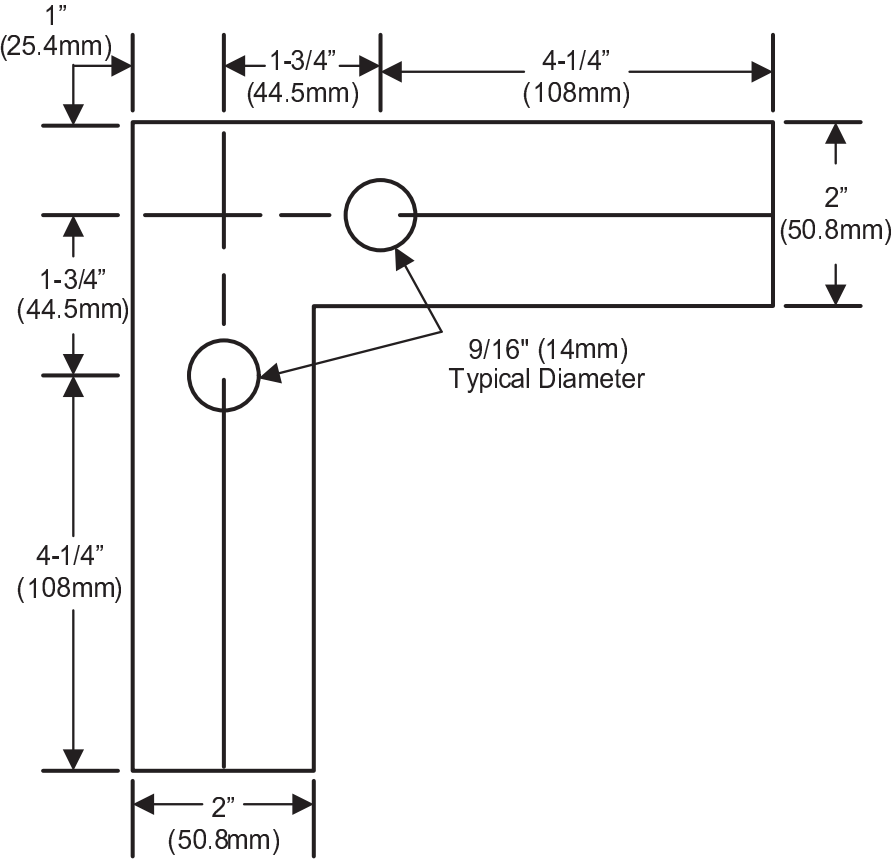

5.2 Condenser Weights and Connection Sizes

Table 4 Condenser net weights and pipe connection sizes

Model #	Number of Fans	Number of Circuits	Connection Size, OD, In.		Net Weight lb (kg)
			Hot Gas	Liquid	
Standard Models					
083	1	1	7/8	5/8	295 (134)
104	1	1	1-1/8	5/8	315 (143)
104	1	2	7/8	1/2	315 (143)
165	2	1	1-1/8	7/8	425 (193)
165	2	2	7/8	5/8	425 (193)
205	2	1	1-1/8	7/8	495 (225)
205	2	2	1-1/8	7/8	495 (225)
251	3	1	1-1/8	7/8	500 (227)
251	3	2	1-1/8	7/8	500 (227)
308	3	1	1-5/8	1-1/8	670 (304)
308	3	2	1-3/8	1-1/8	670 (304)
415	4	1	1-3/8	1-1/8	840 (381)
415	4	2	1-3/8	1-1/8	840 (381)
510	4	1	2-1/8	1-5/8	1190 (540)
510	4	2	1-5/8	1-1/8	1190 (540)
616 *	6	1	(2) 1-5/8	(2) 1-1/8	1380 (626)
616	6	2	1-5/8	1-1/8	1380 (626)
830	8	2	1-3/8	1-1/8	1750 (794)
1010	8	2	2-1/8	1-5/8	2640 (1197)
Liebert Quiet-Line™ Models					
063	1	1	1-1/8	5/8	315 (143)
119	2	1	1-1/8	7/8	425 (193)
119	2	2	7/8	5/8	425 (193)
127	2	1	1-1/8	7/8	495 (225)
127	2	2	1-1/8	7/8	495 (225)
143	2	1	1-1/8	7/8	515 (234)
143	2	2	1-1/8	7/8	515 (234)
214	3	1	1-5/8	1-1/8	840 (381)
214	3	2	1-1/8	7/8	840 (381)
286	4	1	2-1/8	1-1/8	1105 (501)
286	4	2	1-1/8	7/8	1105 (501)
409	6	2	1-5/8	1-1/8	1380 (626)
572	8	2	2-1/8	1-1/8	2430 (1102)
R-410A Models					
28K	1	1	1-1/8	7/8	325 (147)
60K	2	1	1-1/8	7/8	475 (215)
90K	3	1	1-1/8	7/8	675 (306)

* Interconnection piping (field-supplied and installed) required. Configure piping for parallel refrigerant flow between condenser sections.

Table 5 Liebert Lee-Temp™ receiver weights and piping connections

Condenser Model #	Receiver Part #	Receivers per Condenser	Weight per Receiver lb. (kg)	Liebert Lee-Temp Connections, ID Sweat, In.		
				Hot Gas Tee	Liquid Line to Head Pressure Valve	Rotalock Valve Receiver Outlet
Standard Models						
DCSL083	1C19982P1	1	100 (45)	1-1/8	7/8	5/8
DCSL104	1C19982P1		100 (45)	1-1/8	7/8	5/8
DCSL165	W-0050		125 (57)	1-3/8	1-1/8	7/8
DCSL205	W-0050		125 (57)	1-3/8	1-1/8	7/8
DCSL251	W-0050		125 (57)	1-3/8	1-1/8	7/8
DCSL308	W-0060		145 (66)	1-3/8	1-1/8	7/8
DCSL415	185011P1		260 (118)	1-3/8	1-1/8	7/8
DCSL616	W-0410 ¹		200 (91)	1-3/8	1-1/8	7/8
DCSL616	179701P1 ²		424 (192)	1-3/8	1-1/8	1-1/8
DCDL104	1C19982P1	2	100 (45)	1-1/8	7/8	5/8
DCDL165	1C19982P1		100 (45)	1-1/8	7/8	5/8
DCDL205	W-0050		125 (57)	1-3/8	1-1/8	7/8
DCDL251	1C19982P1		100 (45)	1-1/8	7/8	5/8
DCDL308	W-0050		125 (57)	1-3/8	1-1/8	7/8
DCDL415	W-0060		145 (66)	1-3/8	1-1/8	7/8
DCDL510	W-0410		200 (91)	1-3/8	1-1/8	7/8
DCDL616	W-0060		145 (66)	1-3/8	1-1/8	7/8
DCDL830	185011P1		260 (118)	1-3/8	1-1/8	7/8
Liebert Quiet-Line™ Models						
DCSL063	1C19982P1	1	100 (45)	1-3/8	1-1/8	7/8
DCST119	W-0050		125 (57)	1-3/8	1-1/8	7/8
DCSL127	W-0050		125 (57)	1-3/8	1-1/8	7/8
DCSL143	W-0060		145 (66)	1-3/8	1-1/8	7/8
DCST214	W-0410		200 (91)	1-3/8	1-1/8	7/8
DCST286	W-0410		200 (91)	1-3/8	1-1/8	7/8
DCDL119	1C19982P1	2	100 (45)	1-3/8	1-1/8	7/8
DCDL127	1C19982P1		100 (45)	1-3/8	1-1/8	7/8
DCDL143	W-0050		125 (57)	1-3/8	1-1/8	7/8
DCDT214	W-0050		125 (57)	1-3/8	1-1/8	7/8
DCDL286	W-0060		145 (66)	1-3/8	1-1/8	7/8
DCDT409	W-0410		200 (91)	1-3/8	1-1/8	7/8
DCDT572	W-0410		200 (91)	1-3/8	1-1/8	7/8
R-410A Models						
DCSL28K	195315P1	1	125 (57)	7/8	5/8	7/8
DCSL60K	195316P1		145 (66)	7/8	5/8	7/8
DCSL90K	196702P1		200 (91)	7/8	5/8	7/8

1. Matchup for 35 to 105°F (2 to 41°C) design temperature range.

2. Matchup for -30 to 105°F (-34 to 41°C) design temperature range.

6.0 ELECTRICAL DATA

Table 6 60Hz electrical condenser data

Model #		083, 104, 28K			165, 205, 60K			251, 308, 90K			415, 510			616			830, 1010		
# of Fans		1			2			3			4			6			8		
Input Voltage	ph	FLA	WSA	OPD	FLA	WSA	OPD	FLA	WSA	OPD	FLA	WSA	OPD	FLA	WSA	OPD	FLA	WSA	OPD
Fan Speed Controlled																			
208/230	1	4.8	6.0	15	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
460		2.5	3.1	15	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
575		1.9	2.4	15	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
208/230	3	—	—	—	8.3	9.5	15	11.8	13.0	15	15.3	16.5	20	23.6	24.8	30	30.6	31.8	40
460		—	—	—	4.2	4.8	15	5.9	6.5	15	7.6	8.2	15	11.8	12.4	15	15.2	15.8	20
575		—	—	—	3.3	3.8	15	4.7	5.2	15	6.1	6.6	15	9.4	9.9	15	12.2	12.7	15
VFD Controlled																			
208/230	3	3.7	4.6	15	7.2	8.1	15	10.7	11.6	15	14.2	15.1	20	N/A	N/A	N/A	N/A	N/A	N/A
460		1.8	2.3	15	3.5	4.0	15	5.2	5.7	15	6.9	7.4	15	N/A	N/A	N/A	N/A	N/A	N/A
Liebert Lee-Temp™ Controlled/Fan-Cycling																			
208/230	3	3.5	4.4	15	7.0	7.9	15	10.5	11.4	15	14.0	14.9	20	21.0	21.9	25	28.0	28.9	35
460		1.7	2.1	15	3.4	3.8	15	5.1	5.5	15	6.8	7.2	15	10.2	10.6	15	13.6	14.0	20
575		1.4	1.8	15	2.8	3.2	15	4.2	4.6	15	5.6	6.0	15	8.4	8.8	15	11.2	11.6	15

FLA = Full Load Amps; WSA = Wire Size Amps; OPD = Maximum Overcurrent Protection Device

Table 7 60Hz condenser electrical data, Liebert Quiet-Line™

Model #		063			119, 127, 143			214			286			409			572		
# of Fans		1			2			3			4			6			8		
Input Voltage	ph	FLA	WSA	OPD	FLA	WSA	OPD	FLA	WSA	OPD	FLA	WSA	OPD	FLA	WSA	OPD	FLA	WSA	OPD
208/230	3	1.8	2.3	15	3.6	4.1	15	5.4	5.9	15	7.2	7.7	15	10.8	11.3	15	14.4	14.9	20
460		0.9	1.1	15	1.8	2.0	15	2.7	2.9	15	3.6	3.8	15	5.4	5.6	15	7.2	7.4	15
575		0.7	0.9	15	1.4	1.6	15	2.1	2.3	15	2.8	3.0	15	4.2	4.4	15	5.6	5.8	15

FLA = Full Load Amps; WSA = Wire Size Amps; OPD = Maximum Overcurrent Protection Device

Table 8 50Hz condenser full load amp values

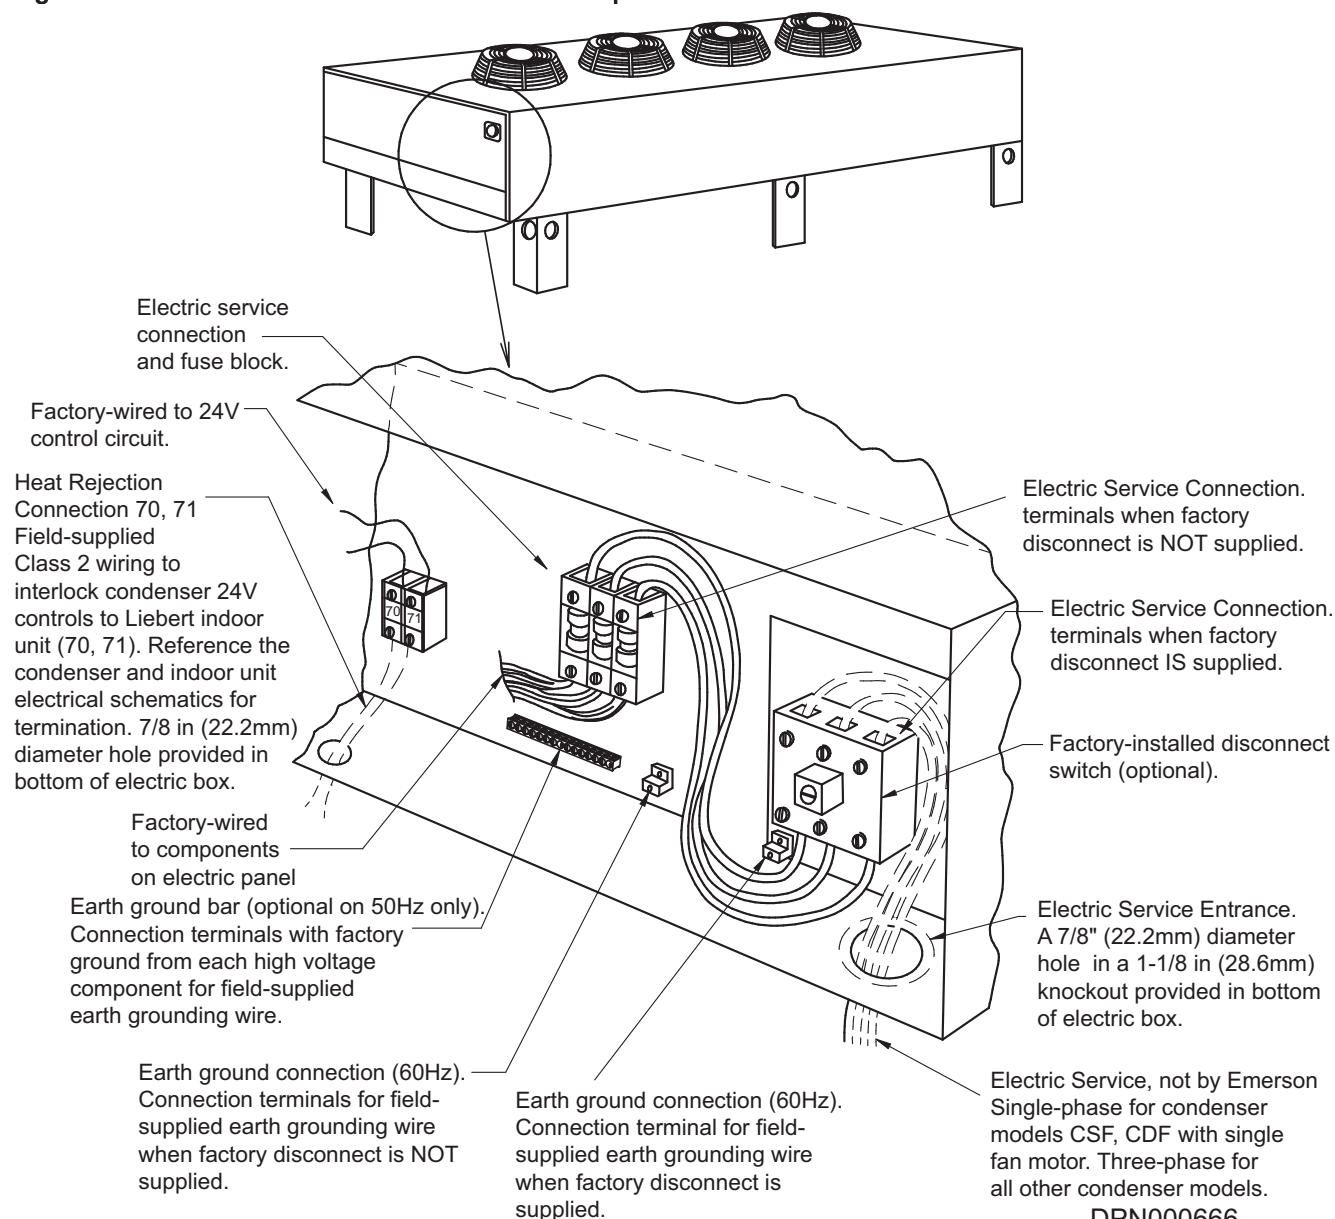
Condenser Control Type		Fan Speed Controlled			VFD Controlled			Liebert Lee Temp Controlled/Fan-Cycling			Liebert Quiet-Line (Liebert Lee-Temp Controlled/Fan-Cycling)		
Model #	# of Fans	Input Voltage - Phase			Input Voltage - Phase			Input Voltage - Phase			Model #	Input Voltage - Phase	
		200/220-1	380/415-3		200/230-3	380/415-3		200/230-3	380/415-3			200/230-3	380/415-3
083, 104	1	4.0	-		3.7	1.8		3.5	1.7		063	1.8	0.9
165, 205	2	—	3.7		7.2	3.5		7.0	3.4		119, 127, 143	3.6	1.8
251, 308	3	—	5.4		10.7	5.2		10.5	5.1		214	5.4	2.7
415, 510	4	—	7.1		14.2	6.9		14.0	6.8		286	7.2	3.6
616	6	—	10.8		—	—		21.0	10.2		409	10.8	5.4
830, 1010	8	—	14.2		—	—		28.0	13.6		572	14.4	7.2

Table 9 Liebert Lee-Temp™ receiver electrical data, 50Hz and 60Hz

Rated Voltage - Single Phase	120			200/208/230		
Watts/Receiver	150	300	450	150	300	450
Full Load Amps	1.4	2.8	4.2	0.7	1.4	2.1
Wire Size Amps	1.8	3.5	5.3	0.9	1.8	2.7
Maximum Overcurrent Protection Device, Amps	15	15	15	15	15	15

The Liebert Lee-Temp receiver requires a separate power feed for heaters. The condenser is not designed to supply power to the receiver.

6.1 Electrical Connections

Figure 7 Electrical field connections for Fan Speed Control Condensers

DPN000666

Rev. 1

Refer to specification sheet for full load amp. and wire size amp ratings.


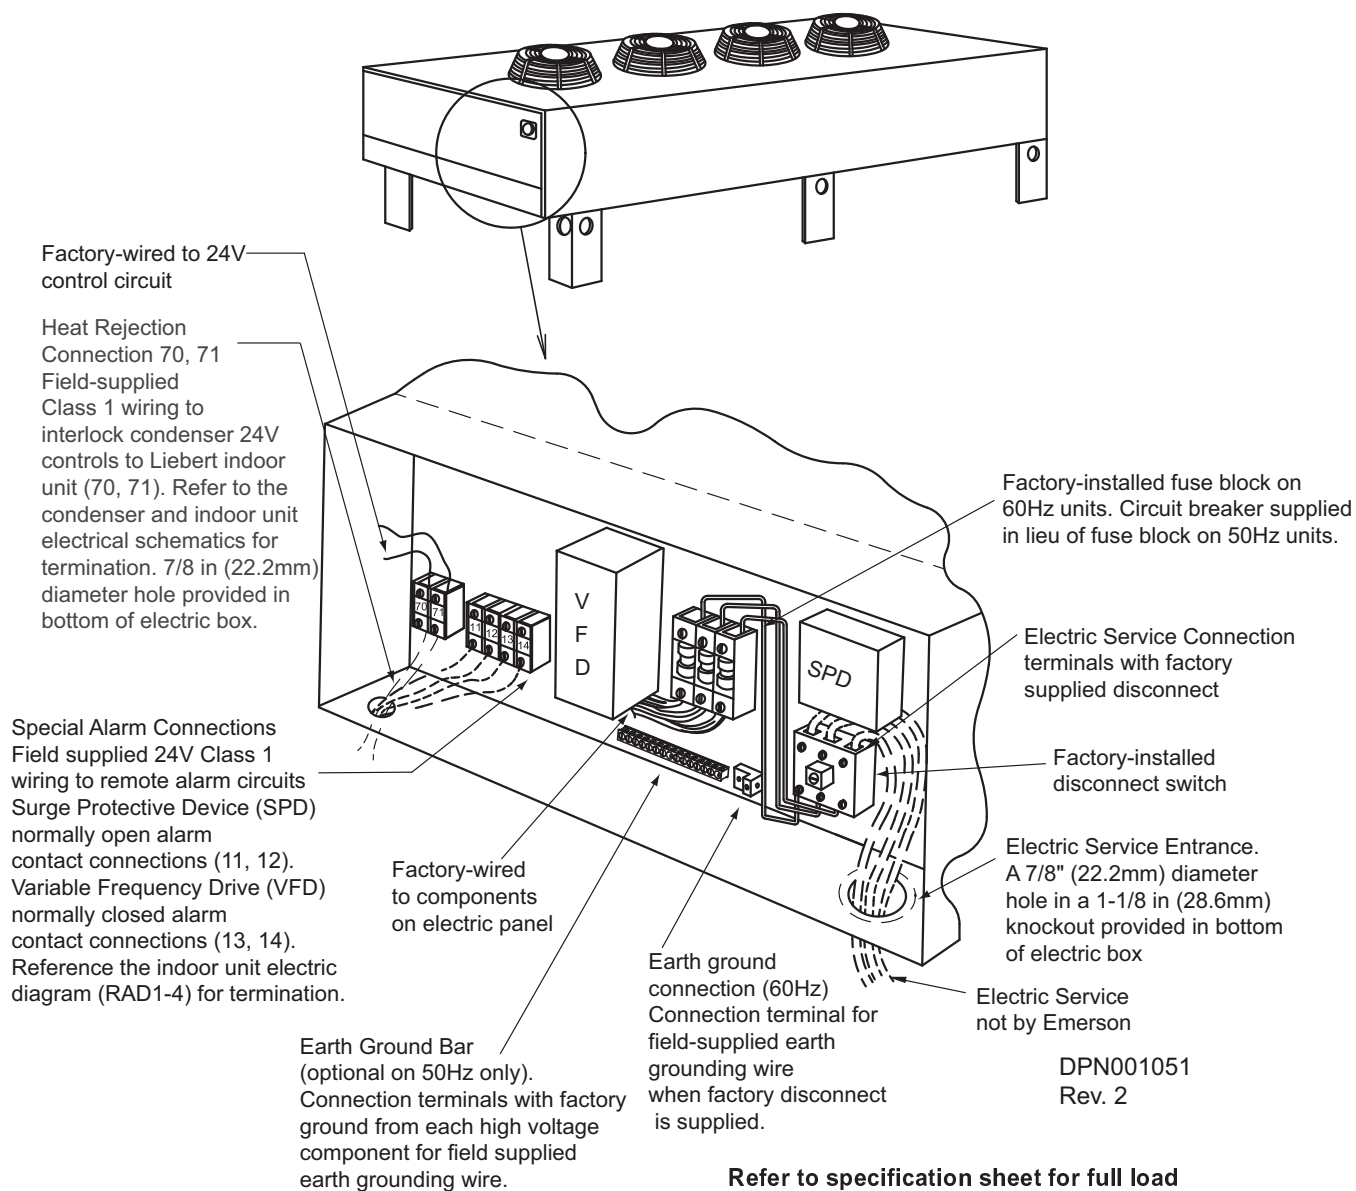
Figure 8 Electrical field connections for VFD control condensers


Figure 9 Electrical field connections for Liebert Lee-Temp™ control condensers

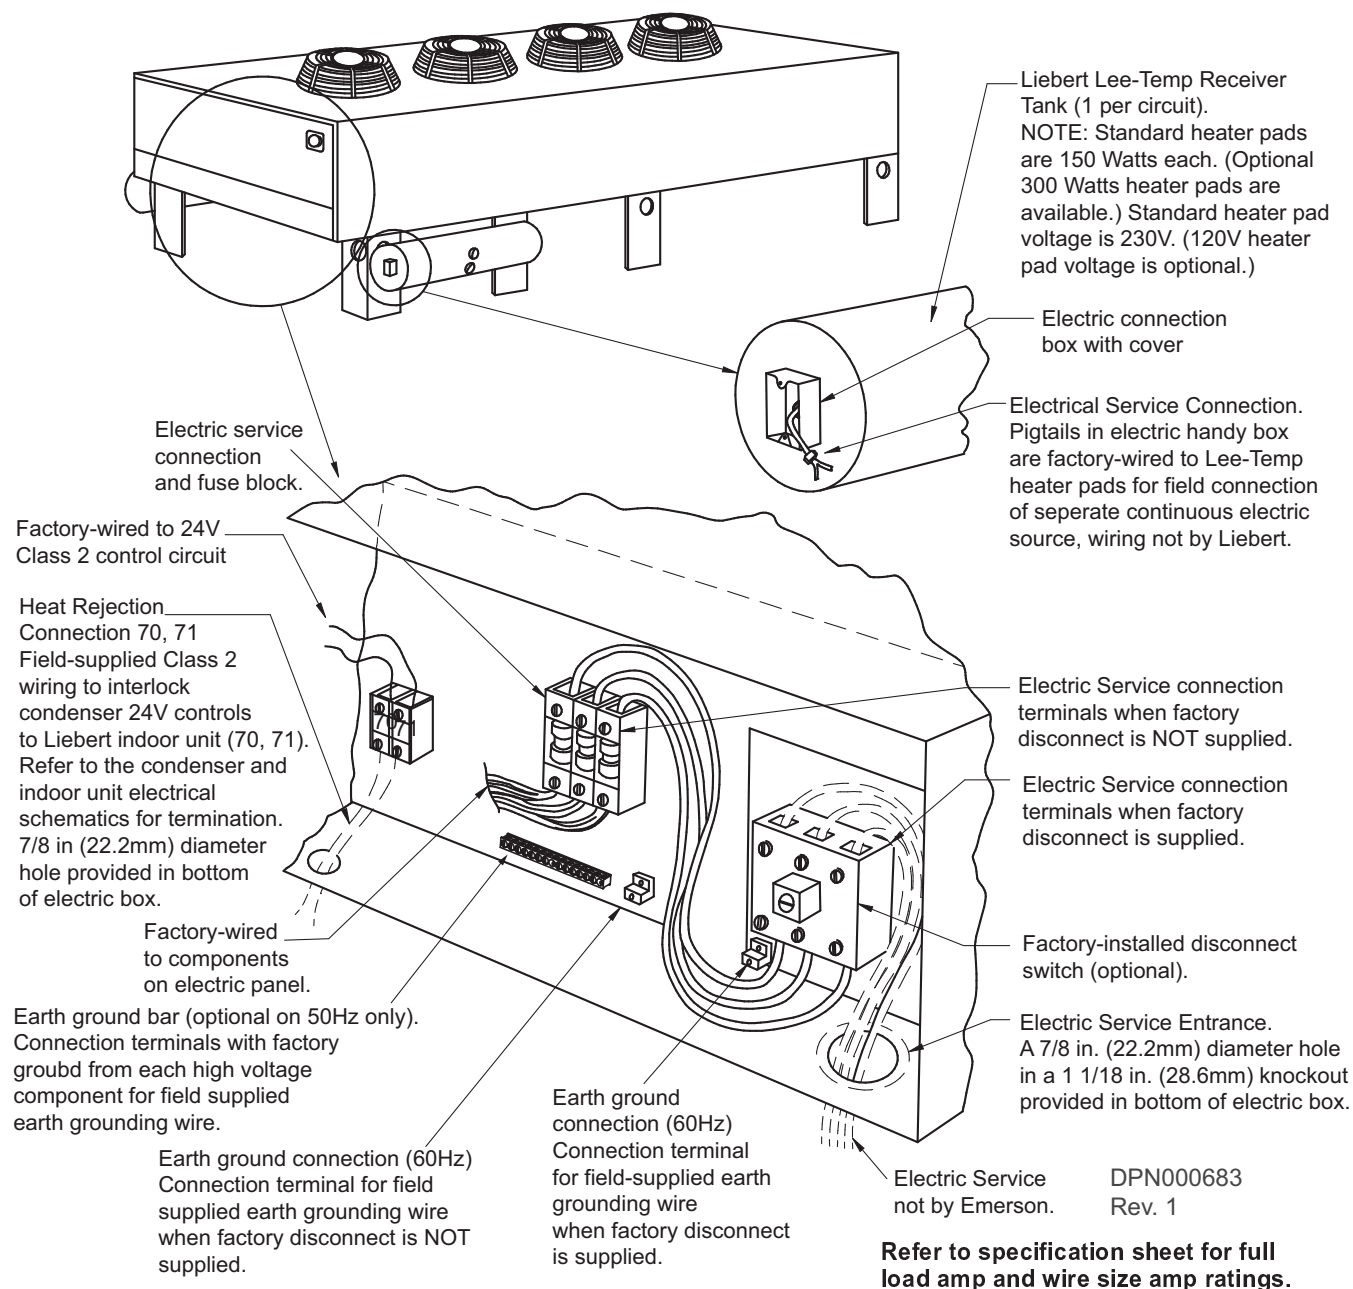

7.0 REFRIGERANT PIPING AND CHARGE PLANNING

7.1 Refrigerant Piping Configurations

Figure 10 Single-circuit piping, VFD and Fan Speed Control, 1-4 fan condensers

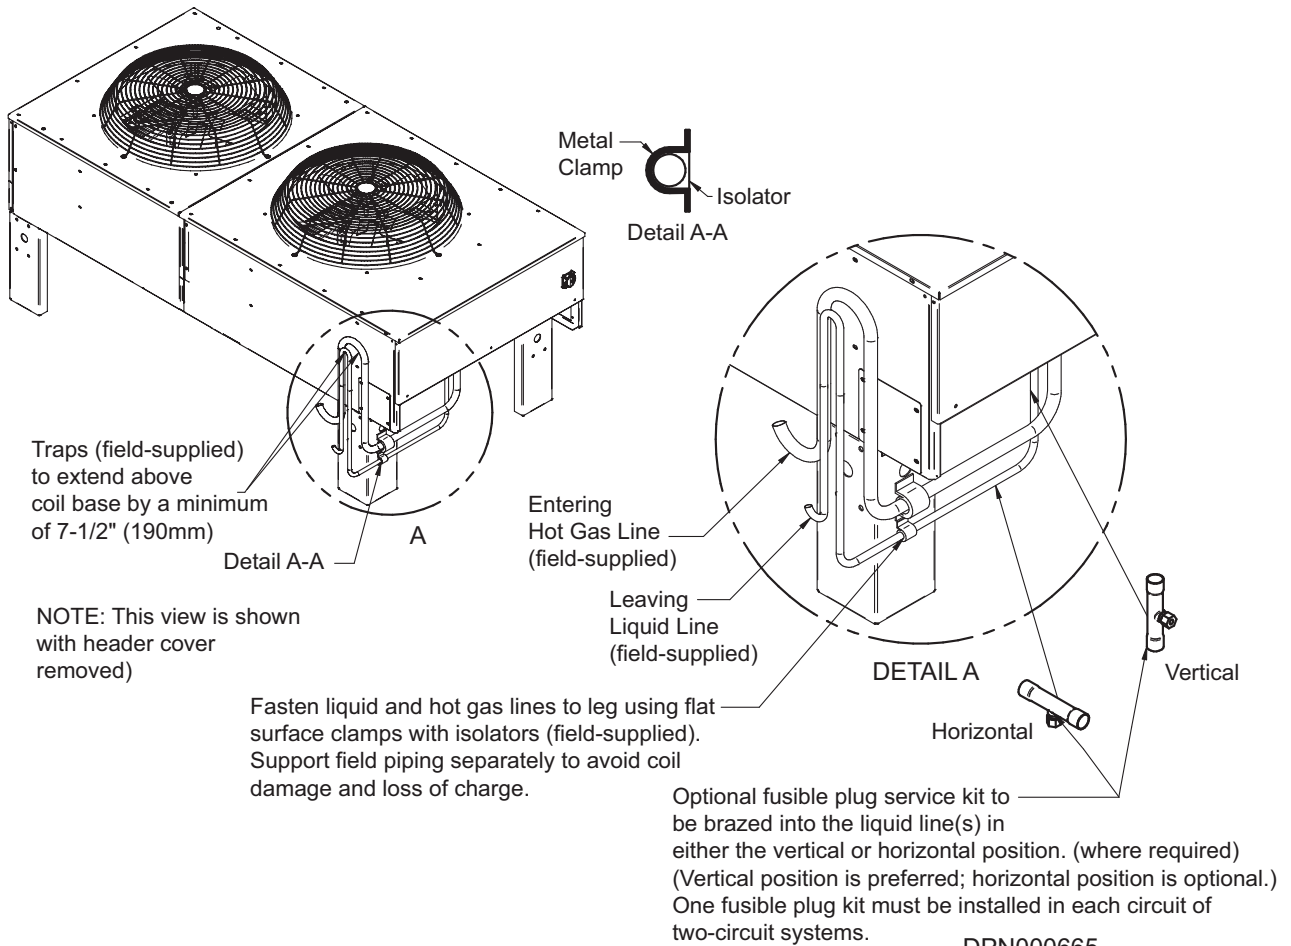

DPN000665
Rev. 4

Figure 11 Dual-circuit piping, VFD and Fan Speed Control, 1-4 fan condensers

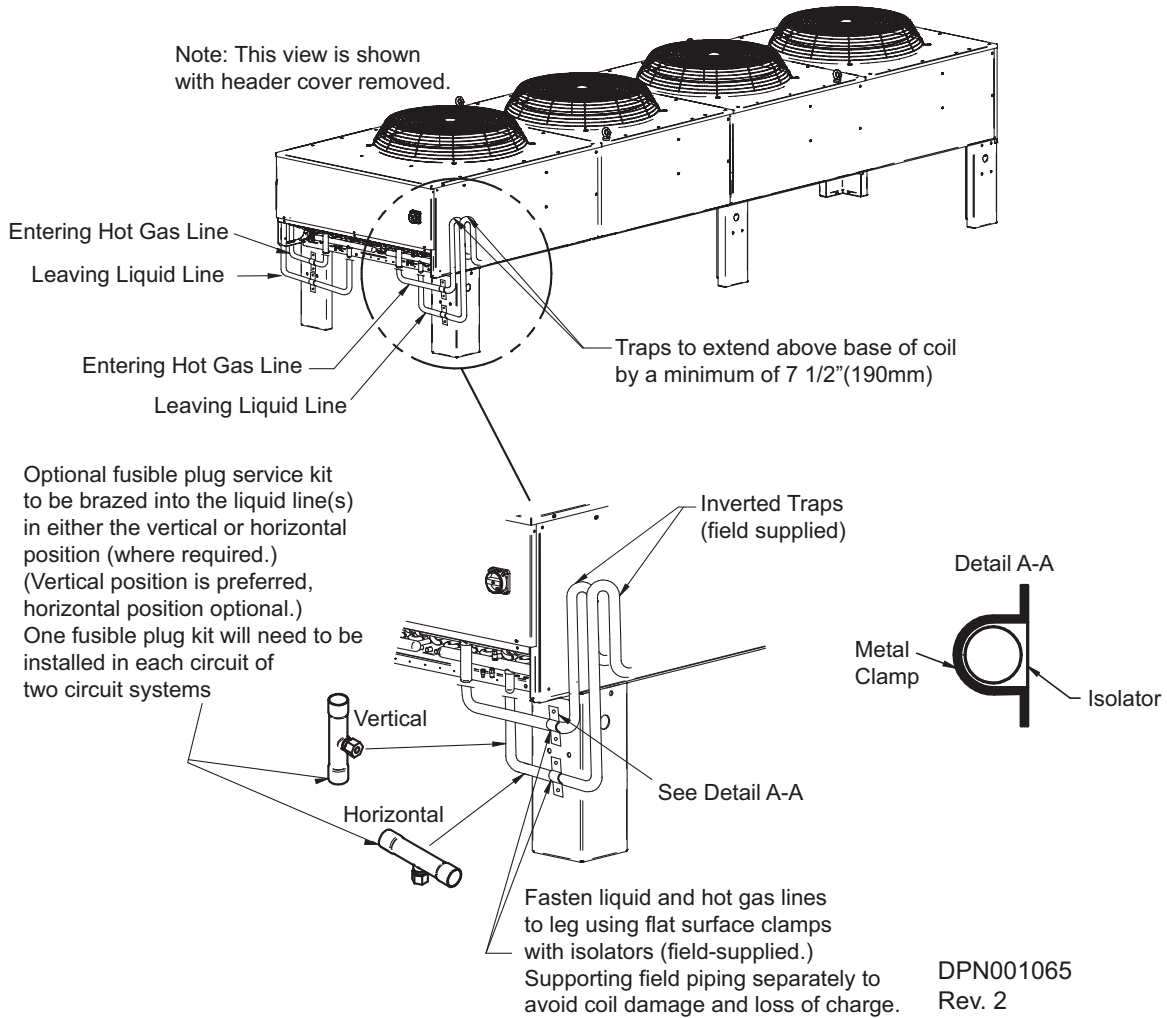


Figure 12 Dual-circuit piping, Fan Speed Control, 6- and 8-fan condensers

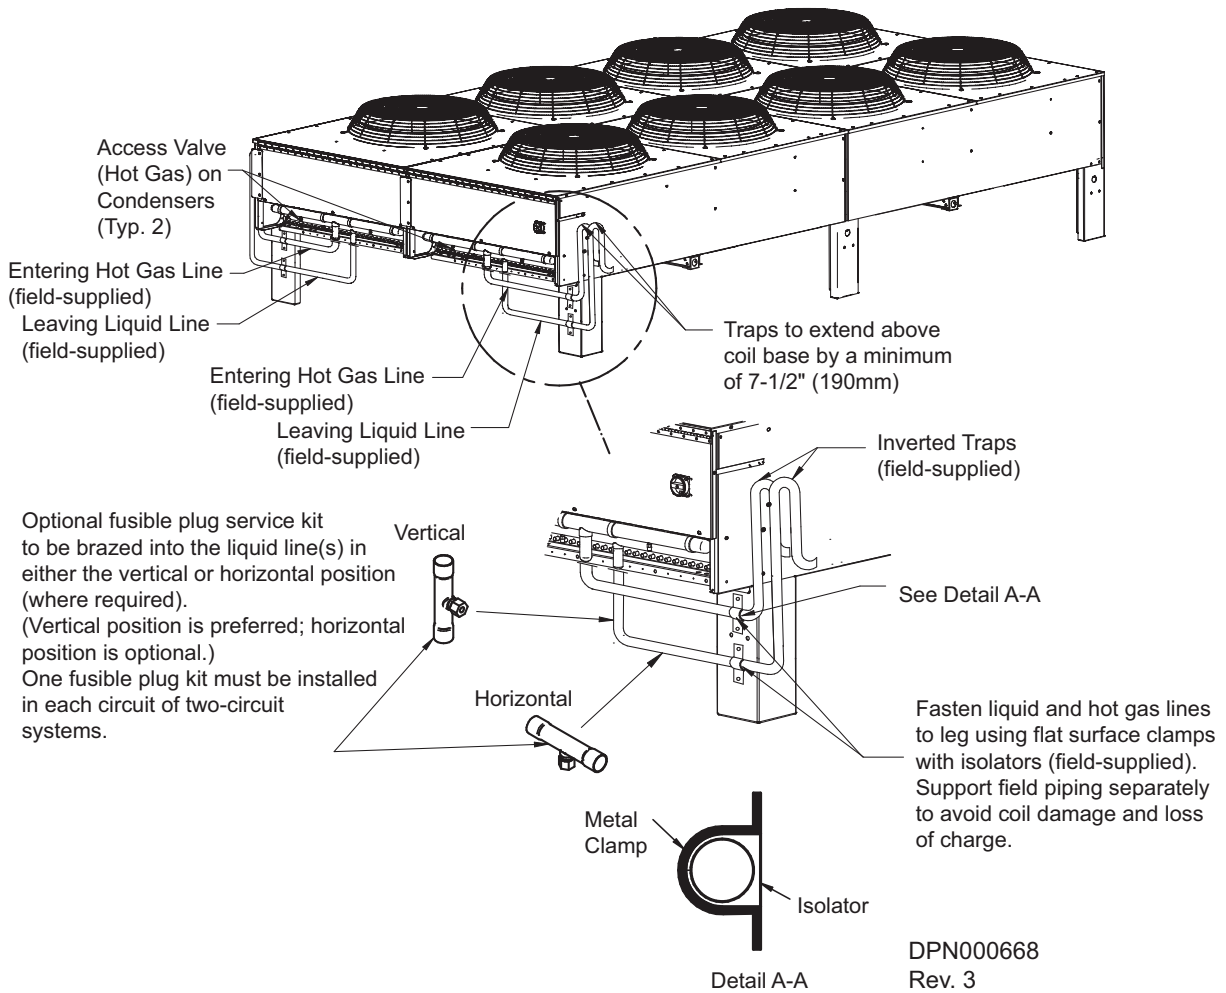


Figure 13 Single-circuit piping, Liebert Lee-Temp™ and Liebert Quiet-Line™ 1-4 fan condensers

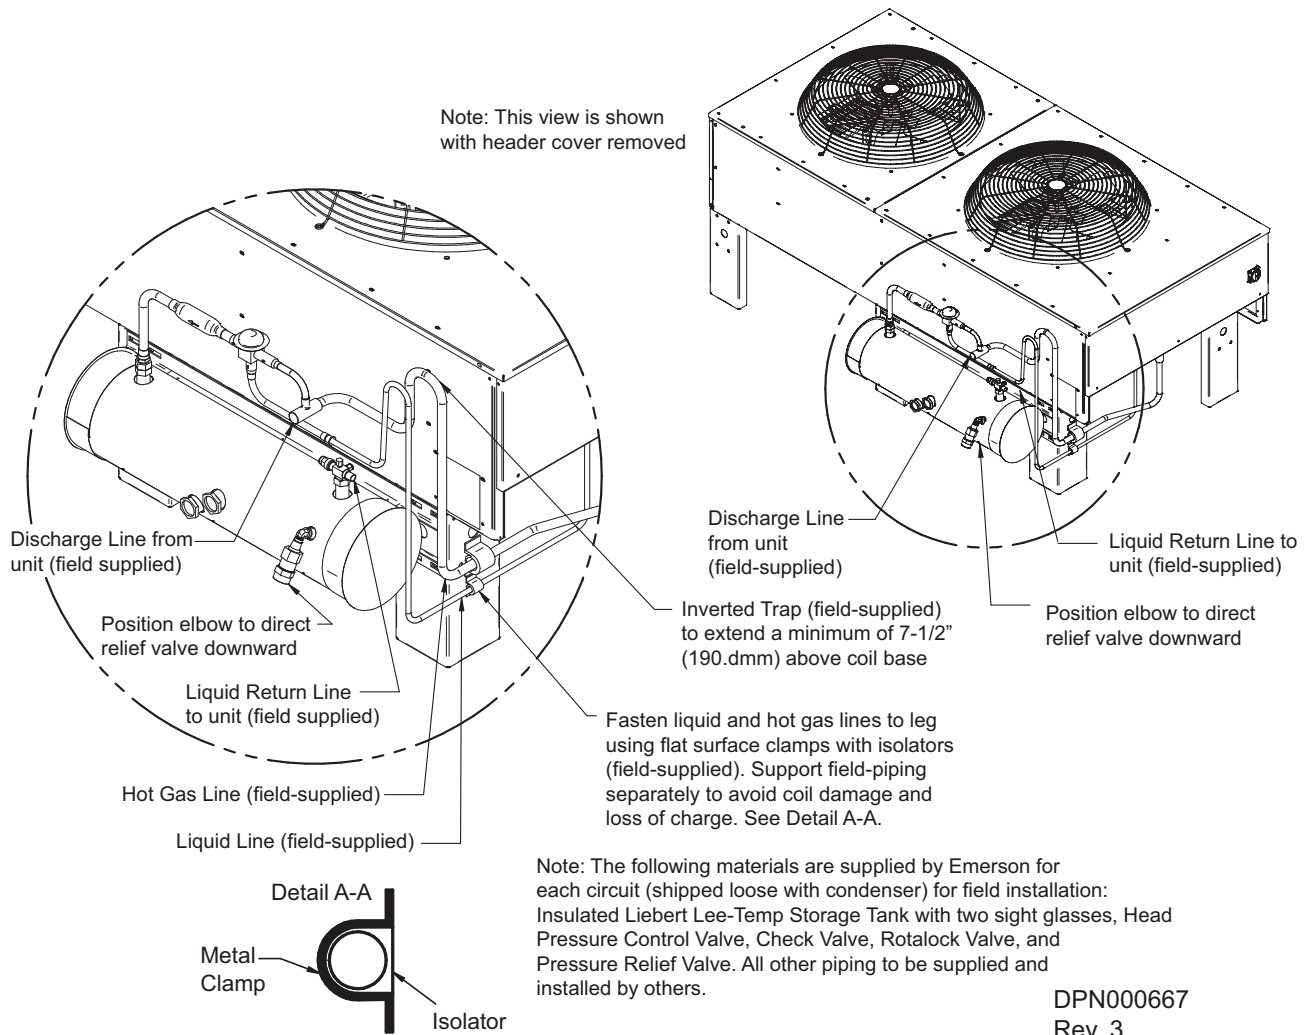


Figure 14 Dual-circuit piping, Liebert Lee-Temp™ and Liebert Quiet-Line™ 1-4 fan condensers


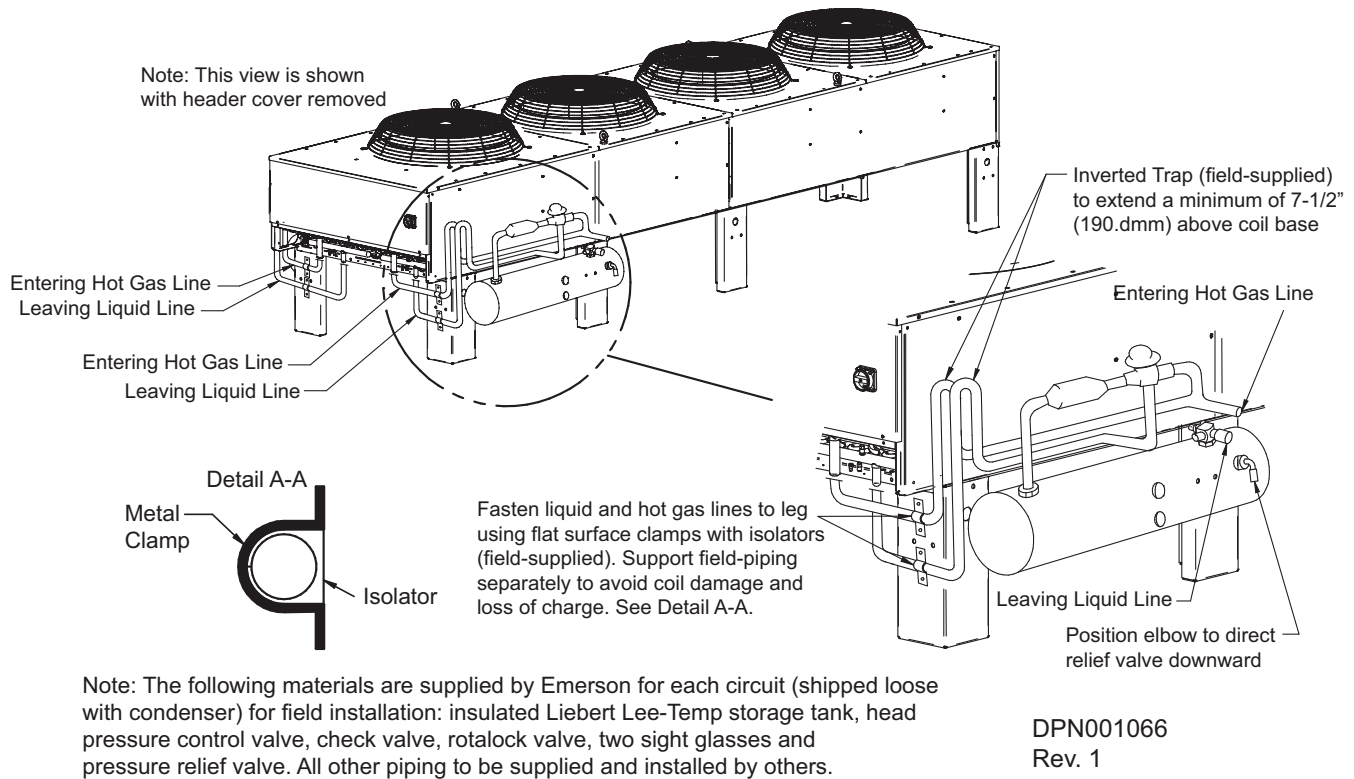


Figure 15 Dual-circuit piping, Liebert Lee-Temp and Liebert Quiet-Line 6- and 8-fan condensers

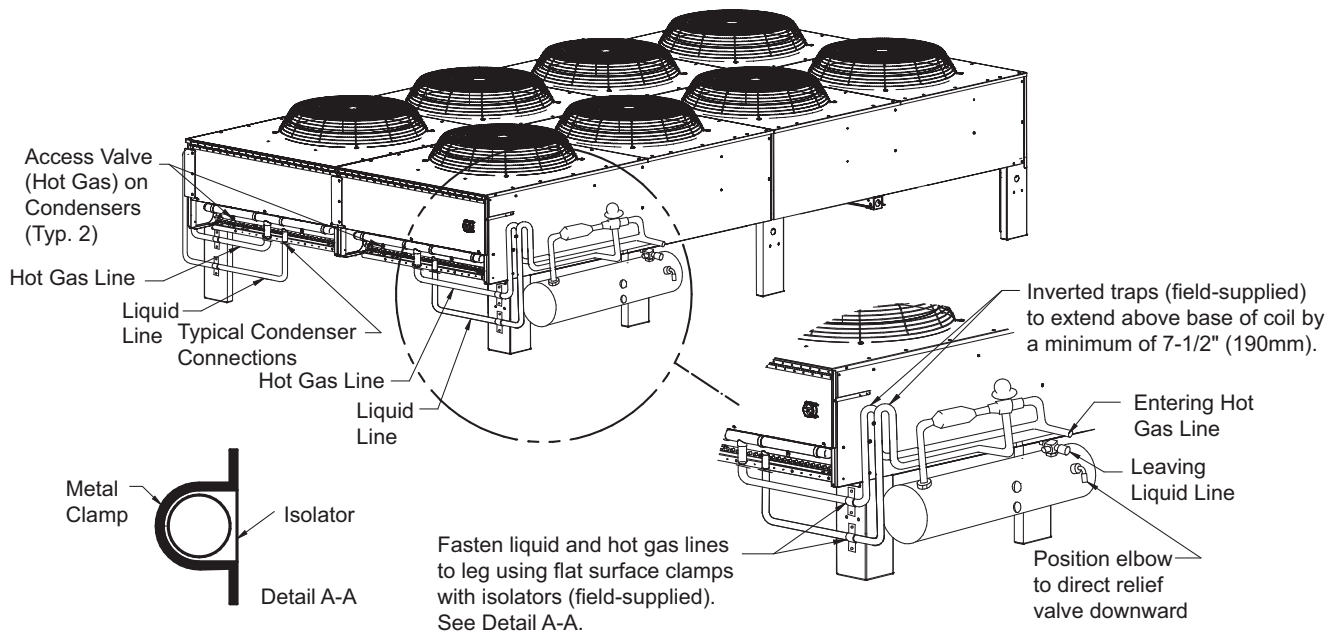


NOTES

The following materials are supplied by Liebert for each circuit (shipped loose with condenser) for field installation: insulated Lee-Temp storage tank, head pressure control valve, check valve, roto-lock valve, two sight glasses and pressure relief valve. All other piping to be supplied and installed by others. Consult factory for proper sizing for runs longer than 150 ft. (45.7m) equiv. length

DPN000670
Rev. 2

Figure 16 General arrangement—Air-cooled models with Liebert Lee-Temp™ control

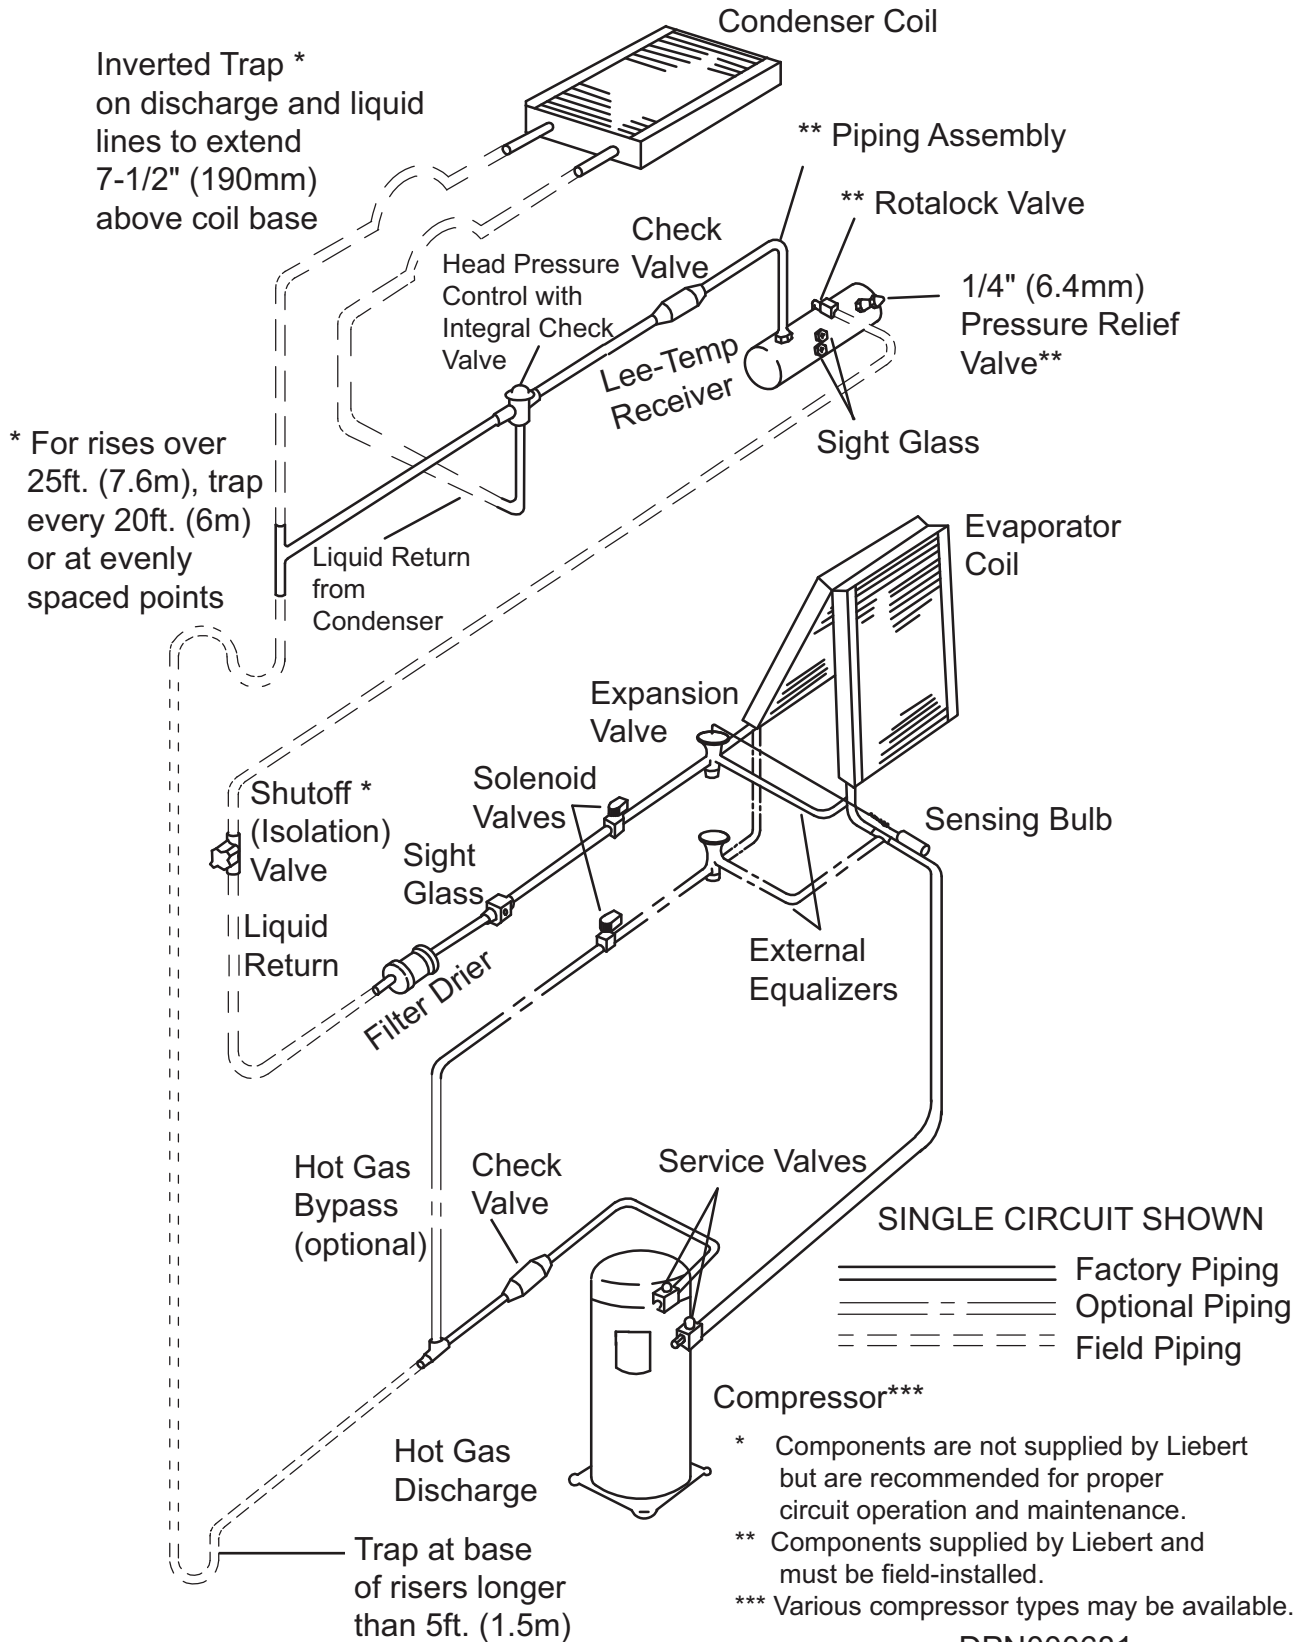

DPN000681

Rev. 1

7.2 Refrigerant Charge Planning Values

Planning for the refrigerant requirements of the completed system is the addition of the charges from Indoor Unit, Condenser (including Liebert Lee-Temp™ receiver, if used) and the interconnecting piping. **Tables 10, 12, 11 and 13** provide the approximate charge required for the condensers and the interconnecting piping. Consult indoor unit manuals for indoor unit charge requirements.

These values can be used for obtaining adequate refrigerant for the system, but should not be used for final charging. Consult indoor unit manual for charging procedures.

Table 10 R-22 and R-407C refrigerant required, approximate

Standard Condenser Models	Approximate R-22 Refrigerant Needed				Approximate R-407C Refrigerant Needed			
	Single Circuit lb (kg)		Dual Circuit lb/circuit (kg/circuit)		Single Circuit lb (kg)		Dual Circuit lb/circuit (kg/circuit)	
	FSC or VFD	Lee-Temp (includes receiver)	FSC or VFD	Lee-Temp (includes receiver)	FSC or VFD	Lee-Temp (includes receiver)	FSC or VFD	Lee-Temp (includes receiver)
083	5 (2.3)	27 (12.3)	3 (1.4)	NA	5 (2.3)	26 (11.8)	3 (1.4)	NA
104	8 (3.6)	39 (17.7)	7 (3.2)	21 (9.5)	8 (3.6)	37 (16.8)	7 (3.2)	20 (9.0)
165	15 (6.8)	53 (24.0)	5 (2.3)	27 (12.3)	15 (6.8)	50 (22.7)	5 (2.3)	26 (11.8)
205	20 (9.1)	76 (34.5)	7 (3.2)	56 (25.3)	19 (8.6)	72 (32.7)	7 (3.2)	54 (24.4)
251	19 (8.6)	75 (34.0)	10 (4.6)	38 (17.2)	18 (8.2)	71 (32.2)	10 (4.6)	36 (16.3)
308	29 (13.2)	113 (51.3)	11 (5.0)	58 (26.3)	28 (12.7)	107 (48.5)	11 (5.0)	55 (24.9)
415	54 (24.5)	210 (95.0)	25 (11.3)	107 (48.4)	51 (23.1)	200 (90.8)	24 (10.9)	102 (46.2)
510	72 (32.7)	N/A	30 (13.6)	149 (67.6)	68 (30.8)	N/A	29 (13.2)	142 (64.4)
616	N/A	N/A	27 (12.3)	113 (51.3)	N/A	See Table 11	26 (11.8)	108 (49.0)
830	N/A	N/A	53 (24)	210 (95.1)	N/A	N/A	51 (23.1)	200 (90.8)
1010	N/A	N/A	60 (27.2)	154 (69.9)	N/A	N/A	57 (25.9)	147 (66.7)
Liebert Quiet-Line™ Condenser Models								
063	N/A	39 (17.7)	N/A	NA	N/A	37 (16.8)	N/A	NA
119	N/A	50 (22.7)	N/A	27 (12.3)	N/A	48 (21.8)	N/A	26 (11.8)
127	N/A	76 (34.5)	N/A	38 (17.2)	N/A	72 (32.6)	N/A	36 (16.3)
143	N/A	126 (57.2)	N/A	64 (29.0)	N/A	120 (54.5)	N/A	61 (27.7)
214	N/A	161 (73.0)	N/A	81 (36.7)	N/A	153 (69.4)	N/A	77 (34.9)
286	N/A	196 (88.9)	N/A	125 (56.7)	N/A	186 (84.4)	N/A	119 (54.0)
409	N/A	N/A	N/A	152 (68.9)	N/A	N/A	N/A	148 (67.2)
572	N/A	N/A	N/A	196 (88.9)	N/A	N/A	N/A	186 (84.4)

Table 11 R-407C refrigerant required for DCSL616 condensers for Liebert XDC™, approximate

Model #	Liebert Lee-Temp Receiver	Receiver Tank Length, in. (mm)	Refrigerant Per Circuit (inc. receiver), lb. (kg)
DCSL616	W-0410 ¹	48 (1219)	164 (75)
	179701P1 ²	96 (2438)	254 (115.2)

1. Matchup for 35 to 105°F (2 to 41°C) design temperature range.

2. Matchup for -30 to 105°F (-34 to 41°C) design temperature range.

Table 12 R-410A refrigerant required, approximate

Single-Circuit Model	VFD, lb (kg)	Liebert Lee-Temp™ (inc. receiver), lb (kg)
28K	7 (3.2)	41 (18.6)
60K	16 (7.3)	75 (34.0)
90K	25 (11.3)	109 (49.4)

Table 13 Interconnecting piping refrigerant charge

Line Size, O.D., in.	R-22, lb/100 ft. (kg/30m)		R-407C, lb/100 ft. (kg/30m)		R-410A, lb/100 ft. (kg/30m)	
	Liquid Line	Hot Gas Line	Liquid Line	Hot Gas Line	Liquid Line	Hot Gas Line
3/8	3.8 (1.7)	—	3.7 (1.7)	—	—	—
1/2	7.3 (3.3)	—	6.9 (3.1)	—	5.0 (2.1)	—
5/8	11.7 (5.3)	2.1 (1.0)	11.0 (5.0)	2.2 (1.0)	10.0 (4.2)	1.1 (0.51)
3/4	16.6 (7.5)	3.0 (1.4)	15.7 (7.1)	3.1 (1.3)	13.0 (5.7)	1.5 (0.67)
7/8	24.4 (11.1)	4.4 (2.0)	23.0 (10.4)	4.5 (1.9)	—	2.3 (1.0)
1-1/8	41.4 (18.9)	7.8 (3.5)	39.3 (17.8)	7.8 (3.5)	—	3.9 (1.8)
1-3/8	63.3 (28.7)	11.8 (5.4)	59.8 (27.1)	11.8 (5.4)	—	—
1-5/8	—	16.7 (7.6)	—	16.7 (7.6)	—	—

GUIDE SPECIFICATIONS

Air-Cooled Liebert Condensers with Direct-Drive Propeller Fan

1.0 GENERAL

1.1 Summary

These specifications describe requirements for a Liebert air-cooled condenser for a Liebert Precision Cooling system. The condenser shall be designed to reject waste heat to outdoor air and to control refrigerant head pressure as outdoor ambient conditions change.

The manufacturer shall design and furnish all equipment in the quantities and configurations shown on the project drawings.

Standard 60Hz units are CSA certified to the harmonized U. S. and Canadian product safety standard CSA C22.2 No 236/UL 1995 for “Heating and Cooling Equipment” and are marked with the CSA c-us logo.

The condenser model number shall be: _____

1.2 Design Requirements

The condenser shall be a factory-assembled unit, complete with integral electrical panel, designed for outdoor installation. (The condenser shall be a draw-through design.)

The condenser shall have a total heat rejection capacity of _____ kW (kBtuh) rated at an outdoor ambient of _____ °F (°C) and a midpoint condensing temperature of _____ °F (°C) and a refrigerant flow to produce a subcooling of 5°F (2.8°C)

The unit is to be supplied for operation using a _____ volt _____ phase, _____ Hz power supply.

1.3 Submittals

Submittals shall be provided with the proposal and shall include: Dimensional, Electrical and Capacity data; Piping and Electrical Connection Drawings.

1.4 Quality Assurance

The specified system shall be factory-tested before shipment. Testing shall include, but shall not be limited to: Quality Control Checks, “Hi-Pot” Test (two times rated voltage plus 1000V, per NRTL agency requirements), and Metering Calibration Tests. The system shall be designed and manufactured according to world-class quality standards. The manufacturer shall be ISO 9001 certified.

2.0 PRODUCT

2.1 Standard Features—All Condensers

Condenser shall consist of condenser coil(s), housing, propeller fan(s) direct-driven by individual fan motor(s), electrical controls and mounting legs. The Liebert air-cooled condenser shall provide positive refrigerant head pressure control to the Precision Cooling indoor unit by adjusting heat rejection capacity. Various methods shall be available to match indoor unit type, minimum outdoor design ambient and maximum sound requirements.

2.1.1 Condenser Coil

Liebert-manufactured coil shall be constructed of copper tubes in a staggered tube pattern. Tubes are expanded into continuous, corrugated aluminum fins. The fins have full-depth fin collars completely covering the copper tubes, which are connected to heavy wall Type “L” headers. Inlet coil connector tubes pass through relieved holes in the tube sheet for maximum resistance to piping strain and vibration. Coil shall be [(single circuit) (dual circuit)]. The hot-gas and liquid lines shall be spun shut and shall include a factory-installed Schrader valve. Coils shall be factory leak-tested at a minimum of 300 psig (2068kPag), dehydrated, then filled and sealed with a low pressure inert gas holding charge for shipment. Field relief of the Schrader valve shall indicate a leak-free system.

2.1.2 Housing

The condenser housing shall be constructed of bright aluminum sheet and divided into individual fan sections by full-width baffles. Structural support members, including coil support frame, motor and drive support, are galvanized steel for strength and corrosion resistance. Aluminum legs shall be provided to mount unit for vertical air discharge and have rigging holes for hoisting the unit into position. An electrical panel shall be inside an integral NEMA 3R weatherproof section of the housing.

2.1.3 Propeller Fan

Propeller fan shall have aluminum blades secured to corrosion protected steel hub. Fans shall be secured to the fan motor shaft by means of the keyed hub and dual setscrews. Fan diameter shall be 26" (660mm) or less. Fans shall be factory-balanced and run before shipment. Fan guards shall be heavy gauge, close-meshed steel wire with corrosion resistant PVC finish that shall be rated to pass a 675-hour salt spray test.

2.1.4 Fan Motor

Fan motor shall be continuous air-over design and shall be equipped with rain shield and permanently sealed bearing. Motors shall be rigidly mounted on die-formed galvanized steel supports.

2.1.5 Electrical Controls

Electrical controls, overload protection devices and service connection terminals shall be provided and factory wired inside the integral electrical panel section of the housing. A locking disconnect switch shall be factory-mounted and wired to the electrical panel and controlled via an externally mounted locking door handle. An indoor unit interlock circuit shall enable condenser operation whenever indoor unit compressors are active. Only supply wiring and indoor unit interlock wiring are required at condenser installation.

2.2 Specific Features by Condenser Type

2.2.1 Variable Frequency Drive (VFD) Condenser (1-4 Fan)

The VFD condenser shall have a variable frequency drive controlling one inverter duty, variable speed motor and On/Off fan motor(s) (for multiple fan models only) to vary the airflow across the coil. The VFD shall use one or more pressure transducers to sense refrigerant pressure to adjust fan speed to a positive head pressure control range. The inverter duty motor shall have permanently lubricated ceramic ball bearings. The Liebert variable frequency drive control system shall provide overload protection for the variable speed motor. On/Off fan motor(s) shall have individual internal overload protection and shall be controlled by ambient air thermostat(s) increasing/decreasing condenser capacity in stepped increments. Motors shall have a TEAO enclosure and a full speed of 1140RPM @ 60Hz (950RPM @ 50Hz). An internal Surge Protective Device (SPD) shall protect the VFD from power surges. Alarm contacts for the SPD and VFD shall be provided for monitoring of system components.

The VFD Control system shall provide positive startup and operation in ambient temperature as low as -20°F (-28.9°C). The air-cooled condenser shall have a ____ volt, ____ ph ____ Hz power supply.

2.2.2 Fan Speed Control (FSC) Condenser (1 Fan)

The FSC condenser shall have a fan speed controller sensing refrigerant pressure and varying the speed of a FSC duty motor. Motor shall be single-phase and include built-in overload protection. Motor shall have an ODP enclosure and have a full speed of 1100RPM @ 60Hz (920RPM @ 50Hz).

The fan speed control system shall provide positive startup and operation in ambient temperature as low as -20°F (-28.9°C). The air-cooled condenser shall have a ____ volt, 1 ph, ____ Hz power supply.

2.2.3 Fan Speed Control (FSC) Condenser (2, 3 or 4 Fans)

The FSC condenser shall have a fan speed controller sensing refrigerant pressure and varying the speed of an FSC duty motor. Additional fan motors shall be fixed speed, cycled On/Off by ambient air thermostats to further vary the airflow across the coil. The FSC motor shall be single-phase and include built-in overload protection. FSC motor shall have an ODP enclosure and a full speed of 1100RPM @ 60Hz (920RPM @ 50Hz). The fixed speed motors shall be three-phase and have individual internal overload protection. Fixed speed motors shall have a TEAO enclosure and a full speed of 1140RPM @ 60Hz (950RPM @ 50Hz).

The Lee-Temp control system shall provide positive startup and operation in ambient temperature as low as -20°F (-28.9°C). The air-cooled condenser shall have a ____ volt, 3 ph, ____ Hz power supply.

2.2.4 Fan Speed Control (FSC) Condenser (6 & 8 Fans)

The FSC condenser shall have two fan speed controllers, each sensing the refrigerant pressure of its associated refrigerant circuit and independently varying the speed of the FSC duty motor. Additional motors shall be fixed speed, cycled On/Off by ambient air thermostats to further vary the airflow across the coil. The FSC motors shall be single-phase and include built-in overload protection. FSC motors shall have an ODP enclosure and a full speed of 1100RPM @ 60Hz (920RPM @ 50Hz). The fixed speed motors shall be three-phase and have individual internal overload protection. Fixed speed motors shall have a TEAO enclosure and a full speed of 1140RPM @ 60Hz (950RPM @ 50Hz).

The fan speed control system shall provide positive startup and operation in ambient temperature as low as -20°F (-28.9°C). The air-cooled condenser shall have a ____ volt, 3 ph, ____ Hz power supply.

2.2.5 Liebert Lee-Temp™ Condensers (All Fan Quantities)

Liebert Lee-Temp condensers shall consist of fixed speed fan motor(s), controlled by internal contactor(s). Fans shall run full speed whenever compressors are running. The fixed speed motors shall be three-phase and provide individual internal overload protection. Fixed speed motors shall have a TEAO enclosure and a full speed of 1140RPM @ 60Hz (950RPM @ 50Hz).

Each refrigerant circuit shall have an insulated, heated receiver tank with sight glasses, pressure relief valve, rotalock valve for refrigerant charge isolation and piping assembly with head pressure operated 3-way valve and check valve. Components shall be field-assembled to the condenser. The 3-way valve shall sense refrigerant head pressure and adjust the flooding charge in the condenser coil to adjust the condenser heat rejection capacity. The Liebert Lee-Temp heater shall be [(150W) (300W)], include an integral thermostat to maintain refrigerant temperature at a minimum of 85°F (29°C) and requires a separate power supply of [(208/230-1-60) (120-1-60 volt) (200/230-1-50) (110-1-50)].

This system shall allow system startup and positive head pressure control with ambient temperatures as low as -30°F (-34.4°C).

2.2.6 Liebert Quiet-Line™ Condensers (All Fan Quantities)

Liebert Quiet-Line condensers shall consist of fixed speed fan motor(s), controlled by internal contactor(s). One fan per refrigerant circuit shall run at full speed with the compressor(s). Additional fan motors may be full speed or cycled based on ambient temperatures. Motors shall have a TEAO enclosure, provide individual overload protection and have a full speed of 570RPM @ 60Hz (475RPM @ 50Hz).

Each refrigerant circuit shall have an insulated, heated receiver tank with sight glasses, pressure relief valve, rotalock valve for refrigerant charge isolation and piping assembly with head pressure operated 3-way valve and check valve. Components shall be field assembled to the condenser. The 3-way valve shall sense refrigerant head pressure and adjust the flooding charge in the condenser coil to adjust the condenser heat rejection capacity. The Liebert Lee-Temp heater shall be [(150W) (300W)], include an integral thermostat to maintain refrigerant temperature at a minimum of 85°F (29°C) and requires a separate power supply of [(208/230-1-60) (120-1-60 volt) (200/230-1-50) (110-1-50)].

This system shall allow system startup and positive head pressure control with ambient temperatures as low as -30°F (-34.4°C).

3.0 EXECUTION

3.1 Installation of Air Conditioning Unit

3.1.1 General

Install air conditioning unit in accordance with manufacturer's installation instructions. Install unit plumb and level, firmly anchored in location indicated and maintain manufacturer's recommended clearances.

3.1.2 Electrical Wiring

Install and connect electrical devices furnished by manufacturer but not specified to be factory-mounted. Furnish copy of manufacturer's electrical connection diagram submittal to electrical contractor. Install and wire per local and national codes.

3.1.3 Piping Connections

Install and connect devices furnished by manufacturer but not specified to be factory-mounted. Furnish copy of manufacturer's piping connection diagram submittal to piping contractor.

3.1.4 Field Quality Control

Start cooling units in accordance with manufacturer's startup instructions. Test controls and demonstrate compliance with requirements. These specifications describe requirements for a computer room environmental control system. The system shall be designed to maintain temperature and humidity conditions in the rooms containing electronic equipment.

The manufacturer shall design and furnish all equipment to be fully compatible with heat dissipation requirements.

Ensuring The High Availability Of Mission-Critical Data And Applications.

Emerson Network Power, a business of Emerson (NYSE:EMR), is the global leader in enabling *Business-Critical Continuity™* from grid to chip for telecommunication networks, data centers, health care and industrial facilities. Emerson Network Power provides innovative solutions and expertise in areas including AC and DC power and precision cooling systems, embedded computing and power, integrated racks and enclosures, power switching and controls, infrastructure management, and connectivity. All solutions are supported globally by local Emerson Network Power service technicians. Liebert AC power, precision cooling and monitoring products and services from Emerson Network Power deliver Efficiency Without Compromise™ by helping customers optimize their data center infrastructure to reduce costs and deliver high availability.

While every precaution has been taken to ensure the accuracy and completeness of this literature, Liebert Corporation assumes no responsibility and disclaims all liability for damages resulting from use of this information or for any errors or omissions.
© 2009 Liebert Corporation
All rights reserved throughout the world. Specifications subject to change without notice.
® Liebert is a registered trademark of Liebert Corporation.
All names referred to are trademarks or registered trademarks of their respective owners.

SL-10057_REV2_05-13

Technical Support / Service

Web Site

www.liebert.com

Monitoring

liebert.monitoring@emerson.com

800-222-5877

Outside North America: +00800 1155 4499

Single-Phase UPS & Server Cabinets

liebert.upstech@emerson.com

800-222-5877

Outside North America: +00800 1155 4499

Three-Phase UPS & Power Systems

800-543-2378

Outside North America: 614-841-6598

Environmental Systems

800-543-2778

Outside the United States: 614-888-0246

Locations

United States

1050 Dearborn Drive

P.O. Box 29186

Columbus, OH 43229

Europe

Via Leonardo Da Vinci 8

Zona Industriale Tognana

35028 Piove Di Sacco (PD) Italy

+39 049 9719 111

Fax: +39 049 5841 257

Asia

29/F, The Orient Square Building

F. Ortigas Jr. Road, Ortigas Center

Pasig City 1605

Philippines

+63 2 687 6615

Fax: +63 2 730 9572

Emerson Network Power.

The global leader in enabling *Business-Critical Continuity™*

■ AC Power

■ Embedded Computing

■ Outside Plant

■ Racks & Integrated Cabinets

■ Connectivity

■ Embedded Power

■ Power Switching & Controls

■ Services

■ DC Power

■ Infrastructure Management & Monitoring

■ Precision Cooling

■ Surge Protection